



03 April 2024

Environmental Protection Department
The EIA Ordinance Register Office
27/F Southorn Centre,
130 Hennessy Road,
Wanchai, Hong Kong

By email

Attn: Ms Tiffany Cheung / Environmental Protection Officer (Territory South)23

Dear Madam,

Odour Monitoring Report (April 2023) for Harbour Area Treatment Scheme Stage 2A (Operational Phase)

In compliance with sections 2.38 and 2.41 of the EM&A Manual, we are submitting the Odour Monitoring Report (April 2023) for the Harbour Area Treatment Scheme Stage 2A (Operational Phase) for your review.

If you have any questions or require further information, please feel free to contact me or Mr. Dickson WONG at Tel. 2195 3462, email: leontppun@dsd.gov.hk or dicksonstwong@dsd.gov.hk.

Yours faithfully,

CMA Industrial Development Foundation Limited

PUN Tsz Ping, Leon
Environmental Consultant

Encl.

cc Chemist/ST2/2, DSD

Mr. K. F. LEE

By Email

**Odour Monitoring Report for Harbour Area
Treatment Scheme Stage 2A
(Operational Phase) April 2023**


Report No.: OT_2023002

Prepared by:



**WONG Shing Tat, Dickson
Environmental Consultant**

Reviewed by:



**PUN Tsz Ping, Leon
Environmental Consultant**

Table of Contents

1. Introduction	4
1.1. Background	4
1.2. Objectives of the Monitoring	4
1.3. Objectives of the Report	4
2. Odour Patrol	5
2.1. Monitoring Requirement	5
2.2. Monitoring Frequency	5
2.3. Monitoring Location	5
2.4. Monitoring Parameters	7
3. Odour Patrol Monitoring Result	9
3.1. Odour Intensity	9
3.2. Meteorological Conditions	11
3.3. Odour Patrol Result Discussion	12
4. Summary of Odour Patrol Result	15
4.1. Conclusion	15
4.2. Recommendations	15
4.3. Exceedance	15
5. Odour Measurement	17
5.1. Monitoring Requirement	17
5.2. Monitoring Frequency	19
5.3. Monitoring Location	19
5.4. Monitoring Parameter	20
6. Odour Measurement Result	21
6.1. Odour Concentration and Odour Emission Rate	21
6.2. Odour Measurement Result Discussion	22
7. Summary of Odour Measurement	23
7.1. Conclusion	23
7.2. Recommendation	23
7.3. Correlation between Odour and H ₂ S Concentration	23

List of Tables

Table 2.1	Odour Patrol Monitoring Locations
Table 2.2	Odour Patrol Monitoring of site boundary Locations
Table 2.3	Description of Odour Intensity Levels
Table 3.1	Summary of the Odour Patrol Results 27th April 2023
Table 3.2	Summary of the Odour Patrol Results on 27th December 2023
Table 3.3	Action / Limit Levels of the Odour Patrol
Table 3.4	Comparison between Baseline Data and Impact Data of Odour Patrol
Table 4.1	Event/Action Plan for Operation Air Quality Monitoring
Table 5.1	Odour Monitoring Locations for Odour Measurement
Table 6.1	Summary of Odour Emission Rate
Table 6.2	Comparison between Impact Monitoring Data and Data Obtained from EIA
Table 6.3	Action / Limit Levels of the Odour Measurement
Table 7.1	In-house H ₂ S Concentration from Sensors and Odour Concentration from Odour Measurement for April 2023

List of Appendices

Appendix A	Layout of Odour Patrol Monitoring Locations
Appendix B	Odour Certificates
Appendix C	Field Record and Photo Record
Appendix D	Meteorological Information from the Hong Kong Observatory Station
Appendix E	Layout of Odour Monitoring Locations for Odour Measurement
Appendix F	Odour Measurement Result
Appendix G	Total Odour Emission Rate Extracted from EIA Report

List of Graphs

Graph 1	Overall Correlation between Odour and H ₂ S Concentration
Graph 2	Correlation between Odour and H ₂ S Concentration for Jan 2023 and Apr 2023

1. Introduction

1.1. Background

- 1.1.1. Drainage Services Department appointed ALS Technichem (HK) Pty Limited (“ALS”) and CMA Industrial Development Foundation (“CMA”) to undertake the Odour Monitoring for the Operational Phase of the Harbour Area Treatment Scheme Stage 2A (hereafter referred to as “the Project”).
- 1.1.2. The Project is reference to Environmental Permit No. EP-322/2008/G issued on 9th May 2014 by the Environmental Protection Department (hereafter called EPD) to the Drainage Services Department (hereafter called the DSD) as the Permit Holder and the Environmental Monitoring and Audit (“EM&A”) Manual for the Harbour Area Treatment Scheme (“HATS”) Stage 2A.
- 1.1.3. The odour measurement and odour patrol shall be conducted in the first five years upon commissioning of the expanded SCISTW. For the 1st year, odour monitoring shall be conducted every three months. For the 2nd to 5th year, if the monitoring results from the 1st year comply with the requirements stated in Section 2.38 and Section 2.41 of EM&A Manual, the frequency of the monitoring could be reduced to once every 6 months subject to EPD’s approval.
- 1.1.4. Due to the late renewal of the service contract, some measurements could not be carried out in April 2023. This delay resulted in unclear handover instructions from the Harbor Area Treatment Programme, leading to missing measurements at the designated monitoring locations and site boundaries in 8 PTWs and the SCISTW. In order to fulfill the requirements of the EM&A Manual, a make-up measurement has been arranged in December 2023. This supplementary test aims to make up for the previous omissions and ensure comprehensive monitoring coverage.

1.2. Objectives of the Monitoring

- 1.2.1. The objective of odour patrol and odour measurement is to compare the result obtained from the operational phase with the baseline data at the designated points in order to determine the impact from the operation.

1.3. Objectives of the Report

- 1.3.1. The purpose of the odour monitoring report for the operational phase is to provide analysis and graphical presentation to determine if there are any changes of odour impacts with respect to the implementation of HATS Stage 2A.

2. Odour Patrol

2.1. Monitoring Requirement

2.1.1. An odour patrollist with at least 3 independent trained personnel / competent persons, will be provided to conduct the odour patrol work at 23 designated odour monitoring locations and at the site boundary of 8 Preliminary Treatment Works (PTW) and the Stonecutters Island Sewage Treatment Works (SCISTW). The patrollist will be “calibrated” with reference to European Standard Method: BS EN13725 to ensure the patrollist odour sensitivity within 20- 80 ppb/V. The Odour Certificates are shown in **Appendix B**.

2.1.2. The monitoring shall not be conducted on rainy days. Meteorological conditions including ambient temperature, relative humidity, wind speed and wind direction will be recorded with photo showing the sampling locations during each monitoring.

2.1.3. The independent trained personnel / competent persons shall:

- have their individual odour threshold of n-butanol in nitrogen gas in the range of 20 to 80 ppb/v required by the European Standard Method (EN 13725).
- be at least 16 years of age and willing and able to follow instructions.
- be free from any respiratory illnesses.
- be engaged for a sufficient period to build up and monitor/detect at several monitoring locations;
- not be allowed to smoke, eat, drink (except water) or use chewing gum or sweets 30 min before and during odour intensity analysis;
- take great care not to cause any interference with their own perception or that of others by lack of personal hygiene or the use of perfumes, deodourants, body lotions or cosmetics;
- not communicate with each other about the results of their choices.

2.2. Monitoring Frequency

2.2.1. Odour Patrol shall be conducted every three months for the first year of operation for 8 PTWs and expended SCISTW. The first odour monitoring shall be conducted within one month, after the operation of the upgraded PTWs and expended SCISTW. Subsequent odour monitoring shall be conducted at the 4th, 7th and 10th month.

2.3. Monitoring Location

2.3.1. According to section 2.23 of the EM&A Manual, odour patrol monitoring will be conducted at (1) the odour monitoring locations listed in **Table 2.1** and at (2) the site boundary of 8 PTWs and SCISTW listed in **Table 2.2**.

2.3.2. The layout of odour patrol monitoring locations is shown in **Appendix A**.

Table 2.1 Odour Patrol Monitoring Locations

ASR ID in EIA Report*	Monitoring Station ID	Location
NP3	OM_NP1	King's Road Playground & Skating Area
NP4	OM_NP2	Customs HQ Tower
NP5	OM_NP3	K. Wah Centre
WC3	OM_WC1	Society for the Prevention of Cruelty to Animals
WC4	OM_WC2	Rest Garden near Wan Chai Interchange
C1	OM_C1	Sheung Wan Fire Station
C2	OM_C2	Water Front Divisional Police Station
C3	OM_C3	Sheung Wan Gala Point
FM2	OM_FM1	Western Wholesale Food Market
SB1	OM_SB1	University of Hong Kong Stanley Ho Sports Centre Pitch
SB2	OM_SB2	Home for the Elderly
SB3	OM_SB3	Maclehose Medical Rehabilitation Centre
SB4	OM_SB4	The Duchess of Kent Children's Hospital
CB1	OM_CB1	Cyber Centre
CB2	OM_CB2	Le Meridien Cyberport
WF2	OM_WF1	Wah Ming House, Wah Fu Estate
AB4	OM_AB1	Dairy Farm Ice and Cold Storage
ALC3	OM_ALC1	Shell Ap Lei Chau Depot
SCI1	OM_SCI1	Government Dockyard Offices
SCI3	OM_SCI2	COSCO Hit Terminal
SCI4	OM_SCI3	KMB Depot Office
SCI5	OM_SCI4	Planned FSD Diving Rescue and Diving Training Centre
SCI6	OM_SCI5	Club House

Remark:

* EIA Report reference from Agreement No. CE 43/2005 (EP) Harbour Area Treatment Scheme (HATS) Stage 2A EIA Study – Investigation, Final EIA Report, 3 Air Quality, Table 3.4.

Table 2.2 Odour Patrol Monitoring of site boundary Locations

Monitoring Location
North Point PTW Boundary
Wan Chai East PTW Boundary
Central PTW Boundary
Sandy Bay PTW Boundary
Cyberport PTW Boundary
Wah Fu PTW Boundary
Aberdeen PTW Boundary
Ap Lei Chau PTW Boundary
SCISTW Boundary Location A
SCISTW Boundary Location A1
SCISTW Boundary Location B
SCISTW Boundary Location C
SCISTW Boundary Location D

2.4. Monitoring Parameters

2.4.1. During the patrolling, the meteorological and surrounding information are recorded:

- the prevailing weather condition;
- the wind direction;
- the wind speed;
- location where odour is spotted;
- source of odour;
- perceived intensity of the odour;
- duration of odour; and
- characteristics of the odour detected
- some relevant meteorological data such as daily average temperature, and daily average humidity, on the day of odour patrol should be obtained from the nearest Hong Kong Observatory station for reference.

2.4.2. The perceived intensity is to be divided into 5 levels which are ranked in a descending order as shown in **Table 2.3**.

Table 2.3 Description of Odour Intensity Levels

Odour Level	Odour Intensity	Classification Criteria
0	Not detected	No odour perceives or an odour so weak that it cannot be easily characterised or described
1	Slight	Slight identifiable odour, and slight chance to have odour nuisance
2	Moderate	Moderate identifiable odour, and moderate chance to have odour nuisance
3	Strong	Strong identifiable, likely to have odour nuisance
4	Extreme	Extreme severe odour, and unacceptable odour level

3. Odour Patrol Monitoring Result

3.1. Odour Intensity

3.1.1. The odour patrol monitoring result on 27th April 2023 is summarized in **Table 3.1**. However, no results are reported for the remaining designated monitoring locations and site boundary in 8 PTWs and SCISTW. This is because no measurements were conducted due to unclear handover instructions from Harbour Area Treatment Scheme (HATS) Division.

3.1.2. To fulfill the requirement of the EM&A Manual, make-up measurement was arranged on 27th December 2023, which the results of the remaining designated monitoring locations and site boundary in 8 PTWs and SCISTW are summarized in **Table 3.2**. The field records and photo records at the ASRs during the patrols are attached in **Appendix C**.

Table 3.1 Summary of the Odour Patrol Results 27th April 2023

Monitoring Location	Odour Intensity (0 to 4)			
	Odour Patrol Member			
	O-1	O-2	O-3	O-Mean
OM_SCI1	0	0	0	<u>0</u>
OM_SCI2	0	0	0	<u>0</u>
OM_SCI3	0	0	0	<u>0</u>
OM_SCI4	0	0	0	<u>0</u>
OM_SCI5	0	0	0	<u>0</u>

Table 3.2 Summary of the Odour Patrol Results on 27th December 2023

Monitoring Location	Odour Intensity (0 to 4)			
	Odour Patrol Member			
	O-1	O-2	O-3	O-Mean
OM_NP1	0	0	0	<u>0</u>
OM_NP2	0	0	0	<u>0</u>
OM_NP3	0	0	0	<u>0</u>
North Point PTW Boundary	1 [#]	1 [#]	1 [#]	<u>1[#]</u>
OM_WC1	0	0	0	<u>0</u>
OM_WC2	0	0	0	<u>0</u>
Wan Chai East PTW Boundary	1 [#]	1 [#]	1 [#]	<u>1[#]</u>
OM_C1	0	0	0	<u>0</u>
OM_C2	0	0	0	<u>0</u>
OM_C3	0	0	0	<u>0</u>
Central PTW Boundary	2	2	2	<u>2</u>
OM_FM1	0	0	0	<u>0</u>
OM_SB1	0	0	0	<u>0</u>
OM_SB2	0	0	0	<u>0</u>
OM_SB3	0	0	0	<u>0</u>
OM_SB4	0	0	0	<u>0</u>
Sandy Bay PTW Boundary	1 [#]	1 [#]	1 [#]	<u>1[#]</u>
OM_CB1	0	0	0	<u>0</u>
OM_CB2	0	0	0	<u>0</u>
Cyberport PTW Boundary	1 [#]	1 [#]	1 [#]	<u>1[#]</u>

Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

Monitoring Location	Odour Intensity (0 to 4)			
	Odour Patrol Member			
	O-1	O-2	O-3	O-Mean
OM_WF1	0	0	0	<u>0</u>
Wah Fu PTW Boundary	1 [#]	1 [#]	2 [#]	<u>1[#]</u>
OM_AB1	0	0	0	<u>0</u>
Aberdeen PTW Boundary	1 [#]	1 [#]	1 [#]	<u>1[#]</u>
OM_ALC1	0	0	0	<u>0</u>
Ap Lei Chau PTW Boundary	2 [#]	1 [#]	1 [#]	<u>1[#]</u>
OM_SCI1	0	0	0	<u>0</u>
OM_SCI2	0	0	0	<u>0</u>
OM_SCI3	0	0	0	<u>0</u>
OM_SCI4	0	0	0	<u>0</u>
OM_SCI5	0	0	0	<u>0</u>
SCISTW Boundary Location A	1	1	1	<u>1</u>
SCISTW Boundary Location A1	0	0	0	<u>0</u>
SCISTW Boundary Location B	2	2	2	<u>2</u>
SCISTW Boundary Location C	2	2	2	<u>2</u>
SCISTW Boundary Location D	1	0	0	<u>0</u>

Remark:

1. # The odour was detected with sewage or urine characteristics.

3.2. Meteorological Conditions

- 3.2.1. The meteorological conditions (including temperature, wind speed, wind direction, relative humidity) from the nearest Hong Kong Observatory's Weather Stations for each of the odour patrols were provided for reference in **Appendix D**.

3.3. Odour Patrol Result Discussion

3.3.1. Generally, the odor intensities detected around the SCISTW and PTWs ranged from level 0 to level 2. A level 2 intensity was recorded at three monitoring locations: Central PTW site boundary, Location B and C of the SCISTW site boundary. With reference to the Action/Limit Level shown in **Table 3.3**, the locations met the action level.

3.3.2. SCISTW Site Boundary

A distinct garbage odour was detected at Location B and Location C of the SCISTW site boundary, and the nearby refuse transfer station was identified as the potential source of odour. Therefore, it was concluded that the exceedance was unrelated to the project.

3.3.3. Central PTW Boundary

A distinct solvent odour was detected within the Central PTW Boundary and was accompanied by a continuous side wind. It was identified that the odour came from the maintenance work at the artificial football field in Sun Yat-sen Memorial Park, located opposite the Central PTW (Near the Gate). Therefore, it was concluded that the exceedance was unrelated to the project.

Table 3.3 Action / Limit Levels of the Odour Patrol

Parameter	Action	Limit
Odour Nuisance	Odour Intensity of 2 is measured from odour patrol	Odour Intensity of 3 or above is measured from odour patrol

3.3.4. By comparing our impact monitoring data with the baseline monitoring data, generally, there were no significant difference between two sets of data. A summary table was shown in **Table 3.4**.

Table 3.4 Comparison between Baseline Data and Impact Data of Odour Patrol

Monitoring Location	Operational Phase Baseline*	Operational Phase Impact#
	Odour Intensity (0 to 4)	
OM_NP1	0	0
OM_NP2	0	0
OM_NP3	0	0
North Point PTW Boundary	0	1
OM_WC1	0	0
OM_WC2	0	0
Wan Chai East PTW Boundary	0	1
OM_C1	0	0
OM_C2	0	0
OM_C3	0	0
Central PTW Boundary	0	2
OM_FM1	0	0
OM_SB1	0	0
OM_SB2	0	0
OM_SB3	0	0
OM_SB4	0	0
Sandy Bay PTW Boundary	0	1
OM_CB1	0	0
OM_CB2	0	0
Cyberport PTW Boundary	0	1

Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

Monitoring Location	Operational Phase Baseline*	Operational Phase Impact#
	Odour Intensity (0 to 4)	
OM_WF1	0	0
Wah Fu PTW Boundary	0	2
OM_AB1	0	0
Aberdeen PTW Boundary	0	1
OM_ALC1	0	0
Ap Lei Chau PTW Boundary	0	2
OM_SCI1	0	0
OM_SCI2	0	0
OM_SCI3	1	0
OM_SCI4	0	0
OM_SCI5	0	0
SCISTW Boundary Location A	1	1
SCISTW Boundary Location A1	1	0
SCISTW Boundary Location B	2	2
SCISTW Boundary Location C	3	2
SCISTW Boundary Location D	1	1

Remarks:

1. *The Largest Data throughout the baseline period are extracted.
2. # The Largest Data among the three Odour Patrol Member are extracted.

4. Summary of Odour Patrol Result

4.1. Conclusion

- 4.1.1. In general, the odour patrol results were similar to the baseline data. No exceedances of the action level were recorded at the 23 designated odour monitoring locations, as well as the site boundary of 8 PTWs and SCISTW, except for the Central PTW Boundary, SCISTW Boundary Location B, and Location C. The exceedances at these locations were attributed to the solvent characteristics from maintenance works of Central PTW Boundary and the garbage characteristics in the vicinity of a nearby refuse transfer station of SCISTW respectively.

4.2. Recommendations

- 4.2.1. Based on the odour patrol results, it is recommended to take more attention on 8 PTWs and SCISTW. These sites have indicated the detection of Level 1 odour intensity with sewage or urine characteristics in their respective regions, which suggesting the potential occurrence of odour nuisance events. The attention aimed to ensure the odour nuisance would not be deteriorated.

4.3. Exceedance

- 4.3.1. There was three action level exceedance recorded at Central PTW site boundary, Location B and C of the SCISTW site boundary.

4.3.2. Central PTW Site Boundary

According to the details of the On-site Observation for the Central PTW Boundary recorded in Appendix C, it was confirmed that an odor with solvent characteristics originated from the opposite maintenance work at the 7-a-side soccer pitch (artificial turf pitch) of Sun Yat Sen Memorial Park. This odor was determined to be an occasional occurrence and unrelated to the Central PTW. Therefore, no action is required in this situation.

4.3.3. SCISTW Site Boundary

The Investigation Reports from January, April, July, and October 2022 confirmed that the odour exceedances at Locations B and Location C of the SCISTW site boundary were caused by the West Kowloon Refuse Transfer Station. Therefore, no action is required for these locations as the exceedances were caused by the West Kowloon Refuse Transfer Station, which was not related to the project.

- 4.3.4. **Table 4.1** showed the Event/Action Plan for Operation Air Quality Monitoring.

Table 4.1 Event/Action Plan for Operation Air Quality Monitoring

Event	Action	
	Person-in-charge of Odour Monitoring	DSD
Action Level		
Exceedance of action level	<ol style="list-style-type: none"> 1. Identify source/reason of exceedance; 2. Repeat odour patrol to confirm finding; 3. Repeat odour measurement at exhaust stacks of deodourization system of SCISTW (if exceedance at SCISTW) to confirm finding. 	<ol style="list-style-type: none"> 1. Carry out investigation to identify the source/reason of exceedance. 2. Investigation shall be completed within 2 weeks; 3. Implement more mitigation measures if necessary.
Limit Level		
Exceedance of Limit level	<ol style="list-style-type: none"> 1. Identify source / reason of exceedance; 2. Repeat odour patrol to confirm finding; 3. Repeat odour measurement at exhaust stacks of deodourization system of SCISTW (if exceedance at SCISTW) to confirm finding; 4. Increase monitoring frequency to monthly; 5. If exceedance stops, cease additional monitoring. 	<ol style="list-style-type: none"> 1. Carry out investigation to identify the source/reason of exceedance. Investigation shall be completed within 2 weeks; 2. Rectify any unacceptable practice; 3. Formulate remedial actions; 4. Ensure amended working methods and remedial actions properly implemented; 5. If exceedance continues, consider what mitigation measures shall be implemented.

5. Odour Measurement

5.1. Monitoring Requirement

- 5.1.1. Air samples will be collected by passive sampling technique at the odour monitoring station. A NalophanTM sampling bag will be placed inside an airtight sampler and then drawn to vacuum for sampling. Approximately 60 litres of the gas sample is collected into the sampling bag for testing. A diagram of the passive sampling equipment that will be used for the sampling is shown below:



Figure 1: Passive Sampler

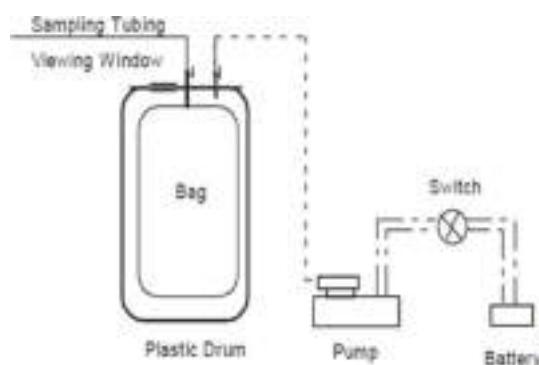


Figure 2: A Schematic Diagram of Sampling Device

- 5.1.2. Air samples in Nalophane bags shall be kept in cool condition not under direct sunlight exposure during the collection. If any condensate is observed on the inner surface of the sampled bag, the sample shall be discarded.
- 5.1.3. All samples collected during the sampling day shall be returned to laboratory at the same day. All olfactometry testing shall be conducted and finished within 24 hours after sampling.
- 5.1.4. The selected laboratory is the local laboratory for the measurement of odour concentration following the European Standard Method BS EN13725:2003 (by dynamic olfactometry). The Reporting Limit for the Olfactometry Analysis is 11 OUE/m³.

- Odour concentration of the sample is determined by Forced-choice Dynamic Olfactometer in accordance to European Standard Method: BS EN13725:2003.
- Testing should be performed by five qualified panellists who have been trained and complied with the requirement of the European Standard Method: BS EN13725:2003 in the range of 20 to 80 ppb/v and a standard deviation of $R < 2.3$.
- Testing shall be started immediately after sample receipt and all testing to be completed with 24 hours after sampling.

5.1.5. The odour concentration is measured by determining the dilution factor required to reach the detection threshold. The odour concentration at the detection threshold is by definition 1 OUE/m³. The odour concentration is then expressed in terms of multiples of the detection threshold.



Figure 3: Olfactory Laboratory with Scentroid™ SS600 Olfactometer

- 5.1.6. During each odour sampling day, one blank sample should be collected for quality control. The sample will be taken by purging pure nitrogen gas into the odour bag directly on site as a blank sample.
- 5.1.7. All equipment for odour measurement and analysis are maintained and calibrated in according to the requirement of the European Standard Method EN13725.

5.2. Monitoring Frequency

- 5.2.1. Odour measurement shall be conducted every three months for the first year of operation for the expanded SCISTW. The first odour measurement shall be conducted within one month after operation of the expanded SCISTW. Subsequent odour measurement shall be conducted at the 4th, 7th and 10th month.

5.3. Monitoring Location

- 5.3.1. According to section 2.36 of the EM&A Manual, odour measurement will be conducted at 15 exhaust stacks of the deodourization system at SCISTW. The odour measurement locations are listed in **Table 5.1**. As suggested by the contractor, the location ID is renamed to better identify the deodourization unit which is different from that on the detailed reporting requirement of odour monitoring report.
- 5.3.2. The layout of odour monitoring locations for odour measurement is shown in **Appendix E**.

Table 5.1 Odour Monitoring Locations for Odour Measurement

Location Point
DOU 1B-1
DOU 1B-2
DOU 1-PS ⁽³⁾
DOU 1-R ⁽²⁾
DOU 2-PS ⁽⁴⁾
DOU 2PS-ACF ⁽⁷⁾
DOU 4-PS ⁽⁵⁾
DOU 5-PS ⁽⁶⁾
DOU 6
DOU 6A
DOU 6B
DOU 8-1
DOU 8-2
DOU 9-1
DOU 9-2

Notes:

- (1) DOU means Deodourization Unit.

- (2) Replace DOU 4-2 stated in Detailed Reporting Requirement of Odour Monitoring Report
(Renaming to distinguish the source of odour is different from that of DOU4)
- (3) Replace DOU 1 stated in Detailed Reporting Requirement of Odour Monitoring Report
(A polishing stage (PS) is added after the treatment of DOU 1 to enhance odour treatment performance)
- (4) Replace DOU 2 stated in Detailed Reporting Requirement of Odour Monitoring Report
(A polishing stage (PS) is added after the treatment of DOU 2 to enhance odour treatment performance)
- (5) Replace DOU 4 stated in Detailed Reporting Requirement
(A polishing stage (PS) is added after the treatment of DOU 4 to enhance odour treatment performance)
- (6) Replace DOU 5 stated in Detailed Reporting Requirement
(A polishing stage (PS) is added after the treatment of DOU 5 to enhance odour treatment performance)
- (7) Replace DOU 3 stated in Detailed Reporting Requirement
(A polishing stage (PS) DOU 2PS-ACF is added after the treatment of DOU 3 to enhance odour treatment performance.)

5.4. Monitoring Parameter

5.4.1. During sampling, following items will be recorded:

- ambient temperature;
- relative humidity;
- wind speed;
- wind direction; and
- photo showing the sampling locations relative to existing land features.

6. Odour Measurement Result

6.1. Odour Concentration and Odour Emission Rate

6.1.1. The odour measurement was conducted on 27th April 2023. The detail of location photo is shown in **Appendix E**.

6.1.2. The odour emission rate is listed in **Table 6.1**. The total odour emission rate is calculated to be 2,568 ou/s. The detail monitoring results for each monitoring location is shown in **Appendix F**.

Table 6.1 Summary of Odour Emission Rate

Location ID	Odour Emission Rate (ou/s)
DOU 1B-1	39
DOU 1B-2	30
DOU 1-PS	414
DOU 1-R	47
DOU 2-PS	243
DOU 2PS-ACF	403
DOU 4-PS	308
DOU 5-PS	130
DOU 6	213
DOU 6A	229
DOU 6B	138
DOU 8-1	20
DOU 8-2	25
DOU 9-1	93
DOU 9-2	236

6.2. Odour Measurement Result Discussion

6.2.1. The total odour emission rate presented in EIA Report Table 3.14 are given in **Appendix G**, the design total mitigated odour emission rate is 11,506.21 ou/s for Option 2 – Decentralized Design.

6.2.2. Comparison between impact monitoring data and data obtained from EIA is shown in **Table 6.2**.

Table 6.2 Comparison between Impact Monitoring Data and Data Obtained from EIA

Total Odour Emission Rate (ou/s)	
Operation Phase Impact	EIA
2,568	11,506.21

6.2.3. According to Table 2.3 of EM&A Manual, the Action / Limit Level is shown in **Table 6.3**. There was no complaint received in April 2023 and December 2023.

Table 6.3 Action / Limit Levels of the Odour Measurement

Parameter	Action	Limit
Odour Nuisance	<ul style="list-style-type: none"> - When two documented complaints are received; or - Measured total odour mission rate from exhaust tacks of deodourization system at SCSITW $\geq 0.9 \times$ total mitigated odour emission rate presented in EIA Report 	<ul style="list-style-type: none"> - Five or more consecutive genuine documented complaints within a week; or - Measured total odour emission rate from exhaust stacks of deodourization system at SCISTW \geq Total mitigated

7. Summary of Odour Measurement

7.1. Conclusion

- 7.1.1. The impact total odour emission rate is smaller than the 90% of total mitigated odour emission rate presented in the EIA report (10,355.59 ou/s). The odour measurement is acceptable and no exceedance of total odour emission rate is recorded.

7.2. Recommendation

- 7.2.1. The operator is reminded to maintain the plants and deodourization units are in good condition and to keep a close monitoring on the in-house H₂S sensors to ensure that no odour nuisance is induced by SCISTW.

7.3. Correlation between Odour and H₂S Concentration

- 7.3.1. To further understand the gas composition, the overall correlation between H₂S concentrations and odour units of available DOUs was plotted in **Graph 1**. In-house H₂S concentration from sensors and odour concentration from odour measurement for April 2023 was listed in **Table 7.1**.

Table 7.1 In-house H₂S Concentration from Sensors and Odour Concentration from Odour Measurement for April 2023

Location ID	Portable H ₂ S Equipment Concentration (ppm) *	Odour Concentration (OU/m ³)
DOU 1B-1	0.027	50
DOU 1B-2	0.027	39
DOU 1-PS	0.004	38
DOU 1-R	0.015	79
DOU 2-PS	0.004	26
DOU 2PS-ACF	0.005	38
DOU 4-PS	0.008	32
DOU 5-PS	<0.001	11
DOU 6	0.004	31
DOU 6A	0.004	25
DOU 6B	<0.001	18


Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

Location ID	Portable H ₂ S Equipment Concentration (ppm) *	Odour Concentration (OU/m ³)
DOU 8-1	0.003	27
DOU 8-2	0.005	34
DOU 9-1	0.03	79
DOU 9-2	0.12	200

Remark:

- *The reported unit for H₂S concentration were converted from ppb to ppm by calculation.

Graph 1 Overall Correlation between Odour and H₂S Concentration

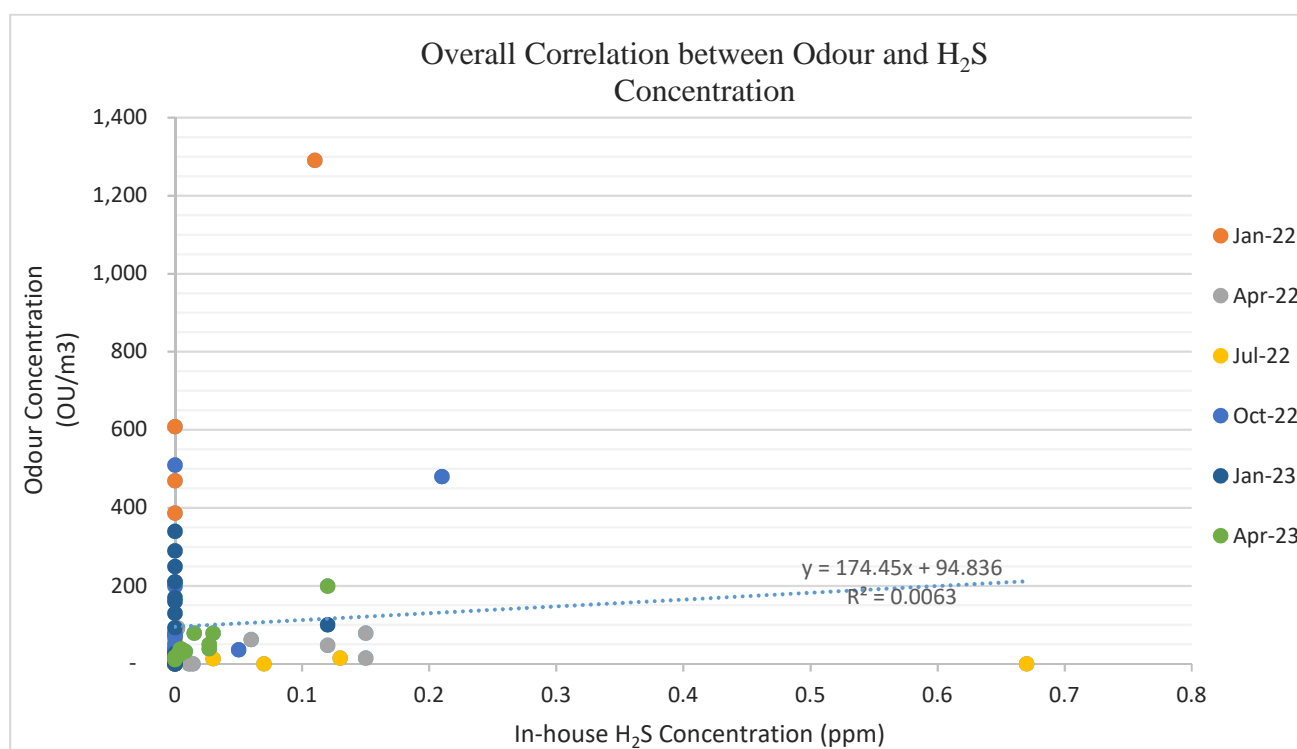


Remark:

- Data smaller than detection limit would be plotted as zero for graph presentation

7.3.2. According to **Graph 1**, no correlation can be established generally. With the above-mentioned observation, the monitoring results in Jan 2023 and Apr 2023 was similar. It is believed that the fine-tuned operating mode including change of quantities of chemical used at the wet chemical scrubbers and replacement of activated carbon at the activated carbon filters after odour measurement exceedance in January 2022 can effectively minimize the odour nuisance. To confirm the correlation between H₂S concentrations and odour units, a graph without exceedance data (data from January 2022) should be established. **Graph 2** show the correlation between Odour and H₂S Concentration for Jan 2023 and Apr 2023.

Graph 2 Correlation between Odour and H₂S Concentration for Jan 2023 and Apr 2023

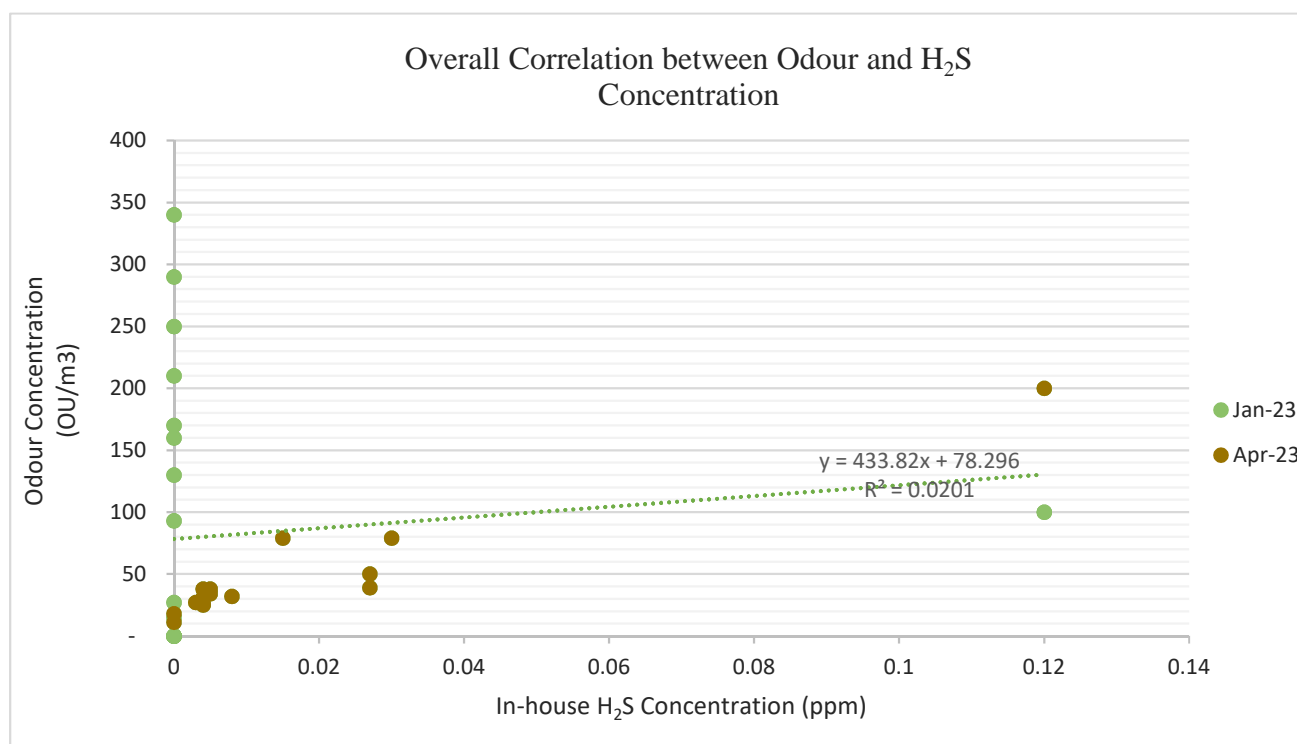

Remark:

1. Data smaller than detection limit would be plotted as zero for graph presentation


7.3.3. Although the data from Jan 2023 and Apr 2023 were seemed to be concentrated near the origin from **Graph 1**, there was also no obvious correlation between these two months from **Graph 2**. As the sample size is still small, more data should be collected to establish the correlation between H₂S concentration and odour concentration.

7.3.4. To conclude, the operators are reminded to maintain the equipment and plants in good condition and have a close monitoring on the performance of the deodourization units.


-End of Report-

Appendix A

Layout of Odour Patrol Monitoring Locations

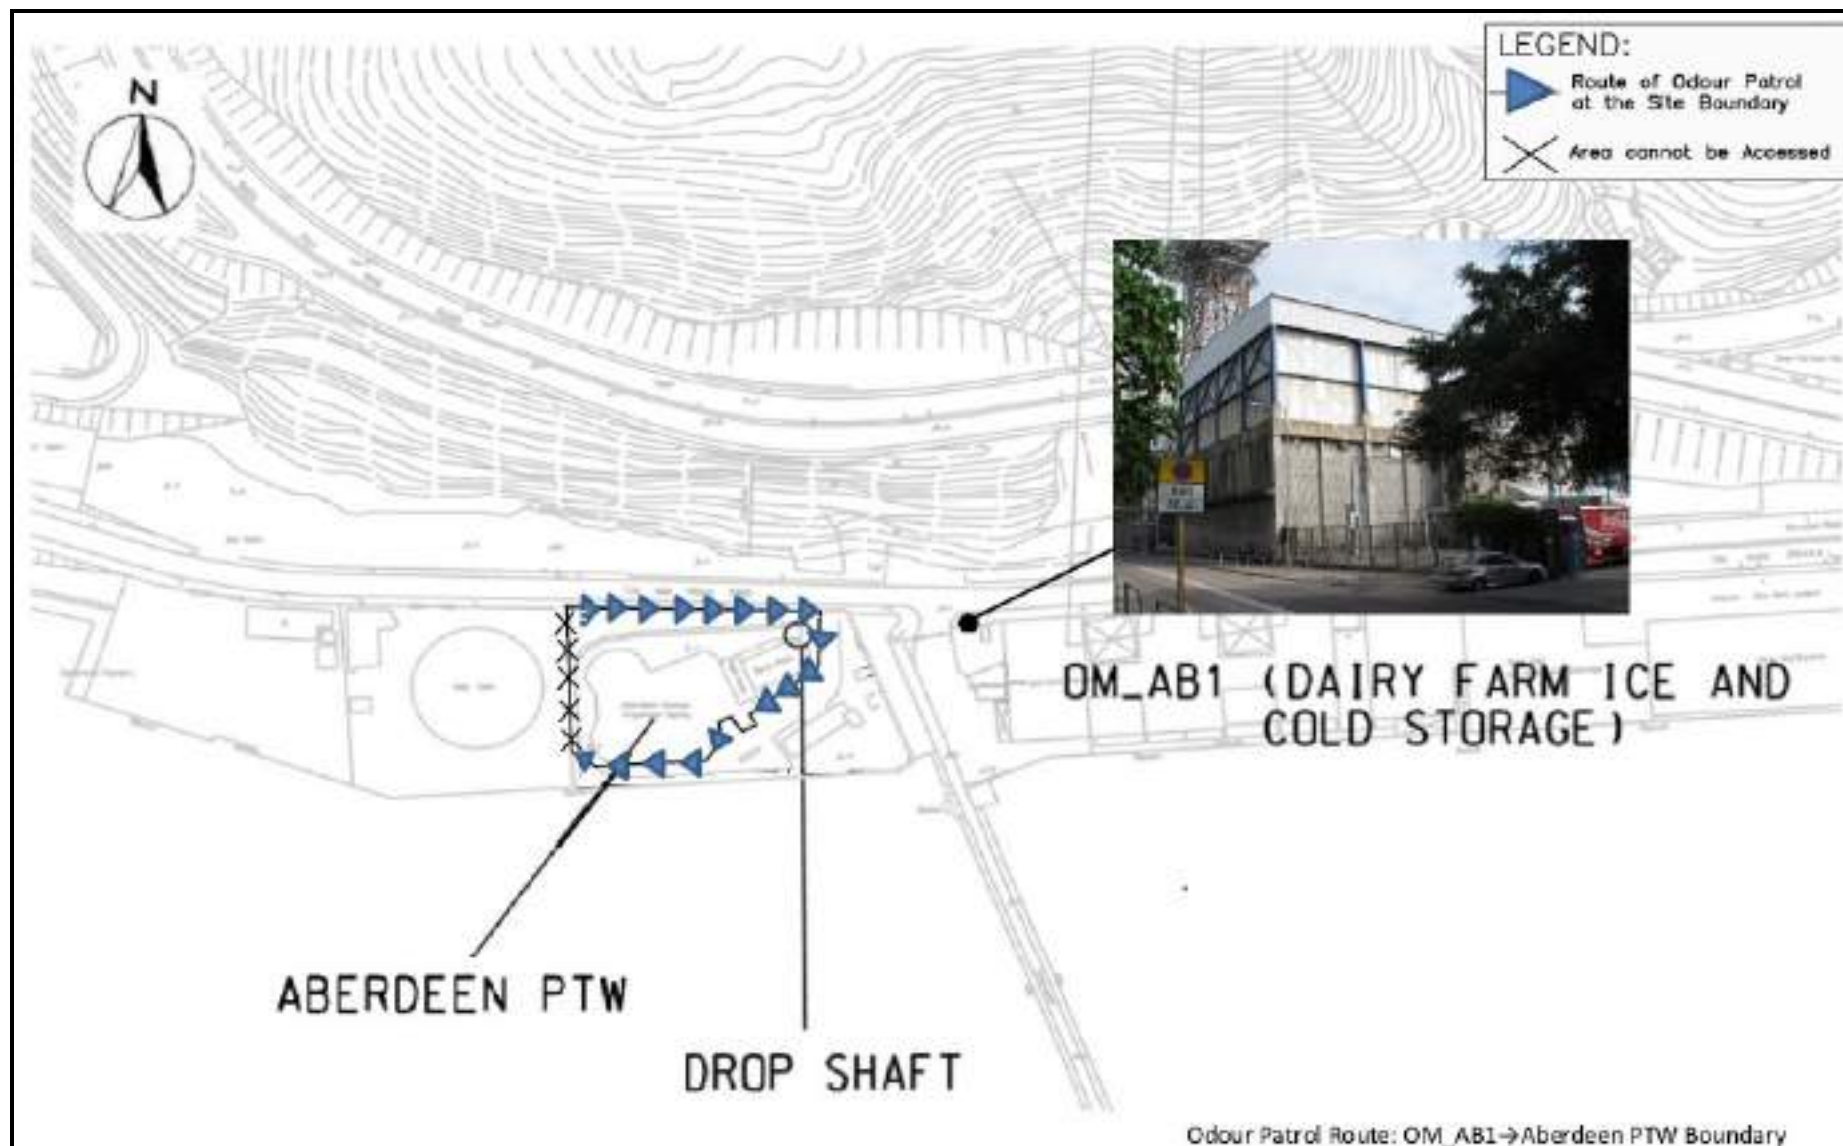

Aberdeen PTW

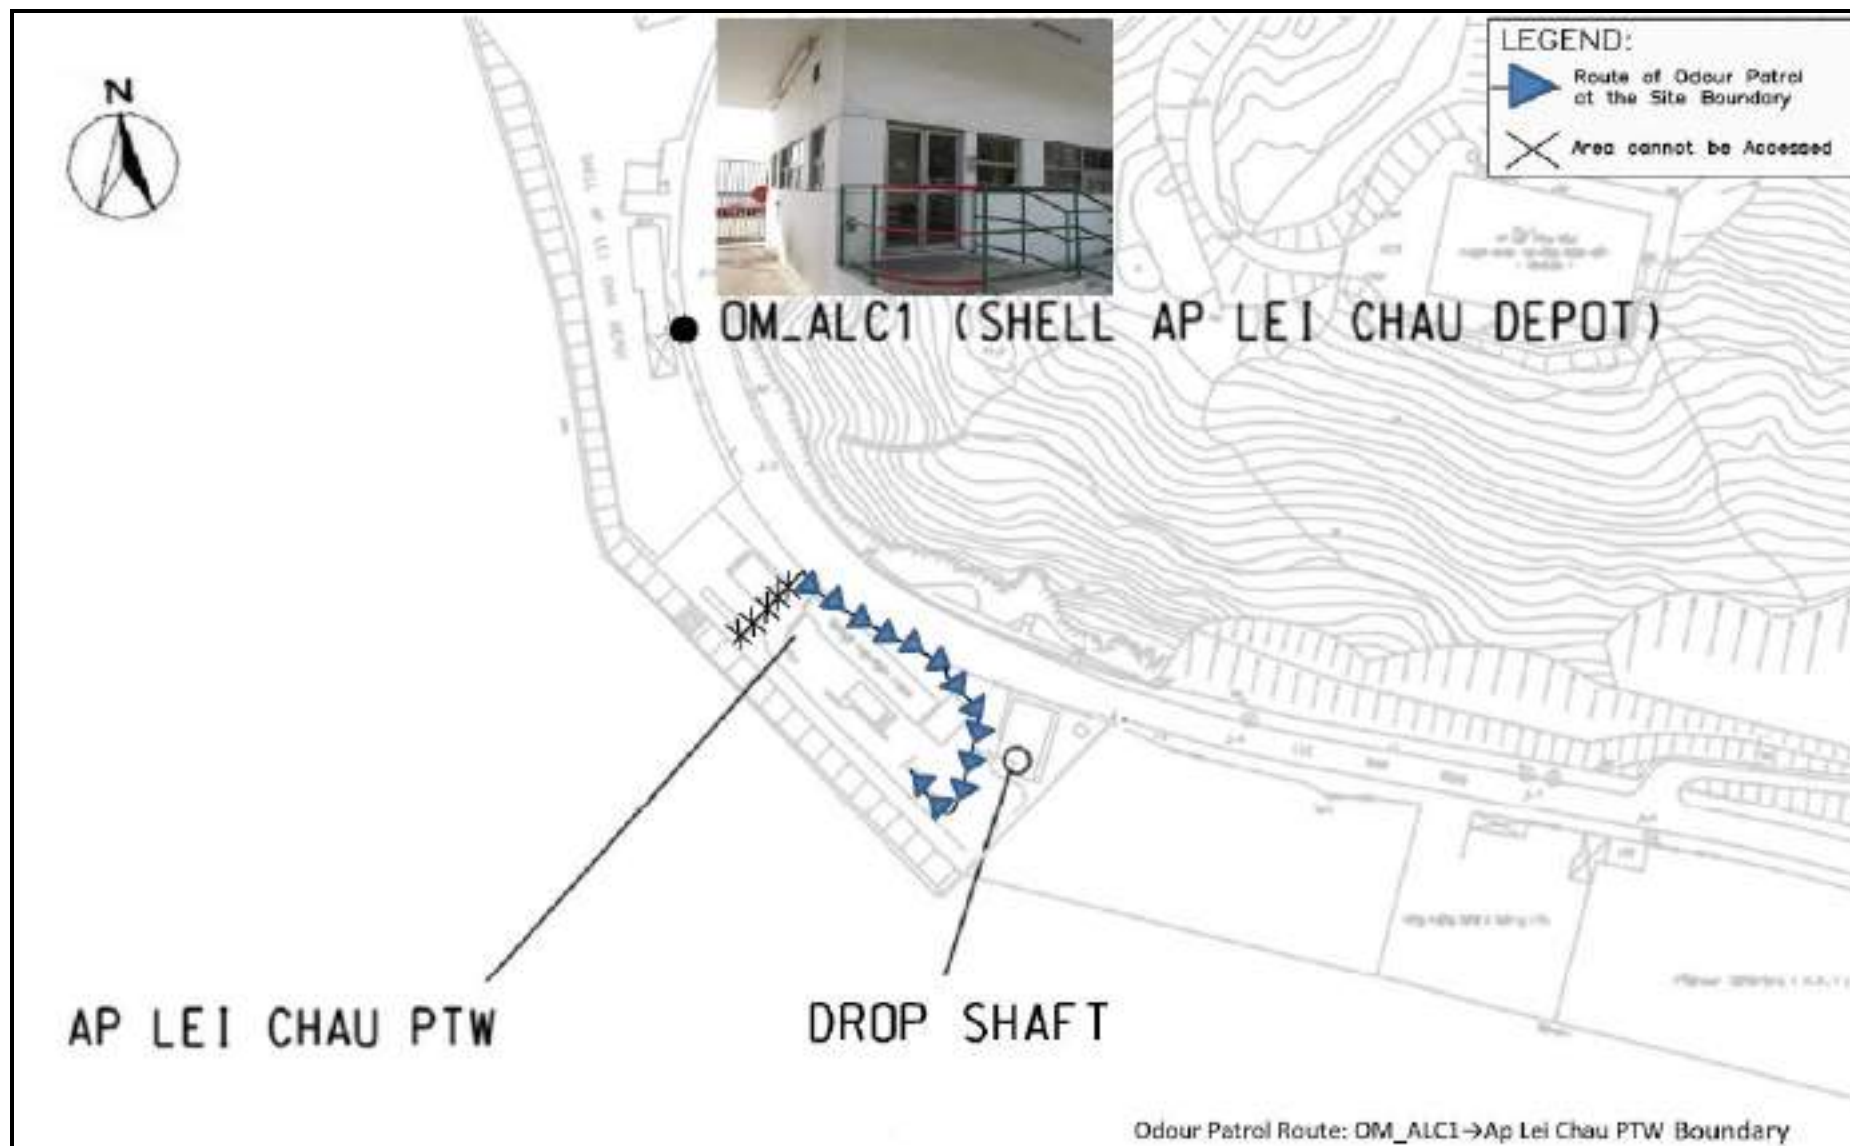


Ap Lei Chau PTW


Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023



Central PTW

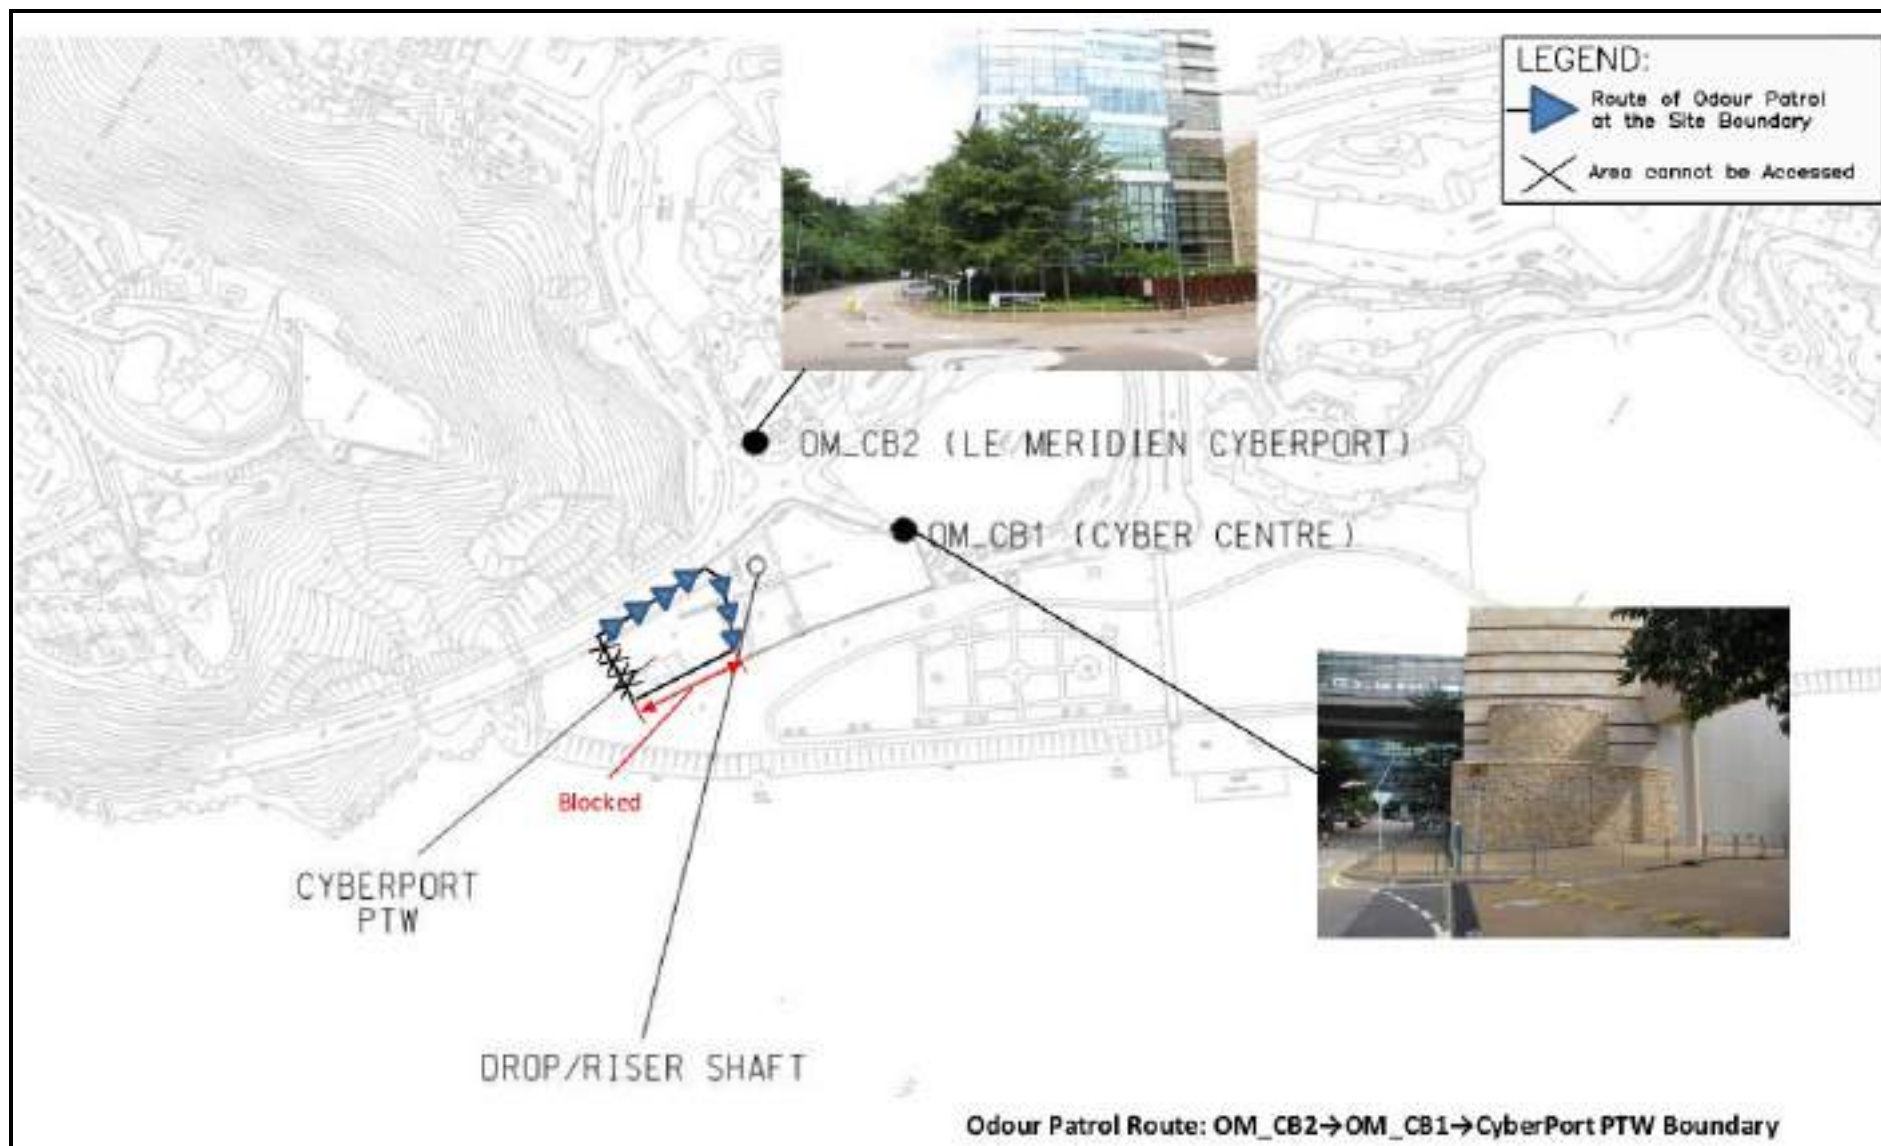


Cybersport PTW

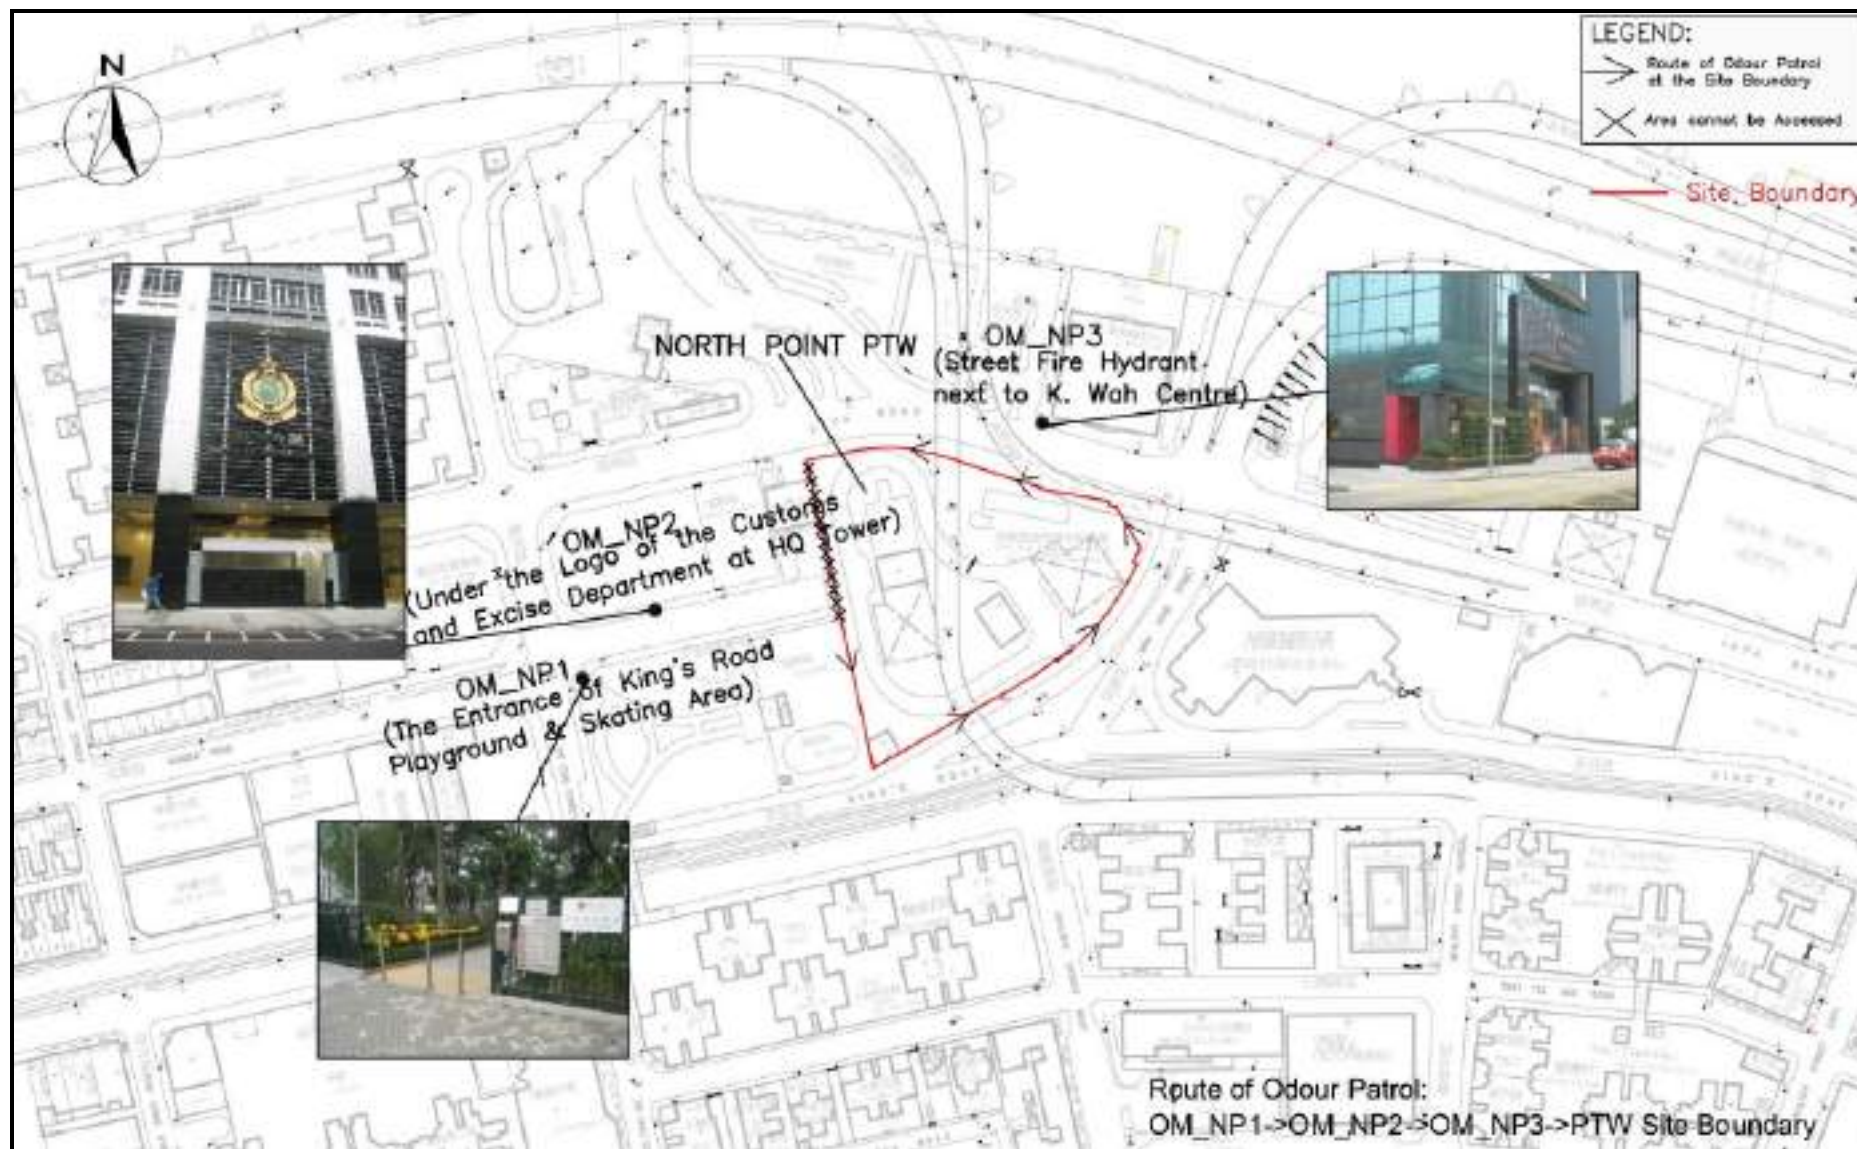


North Point PTW

Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

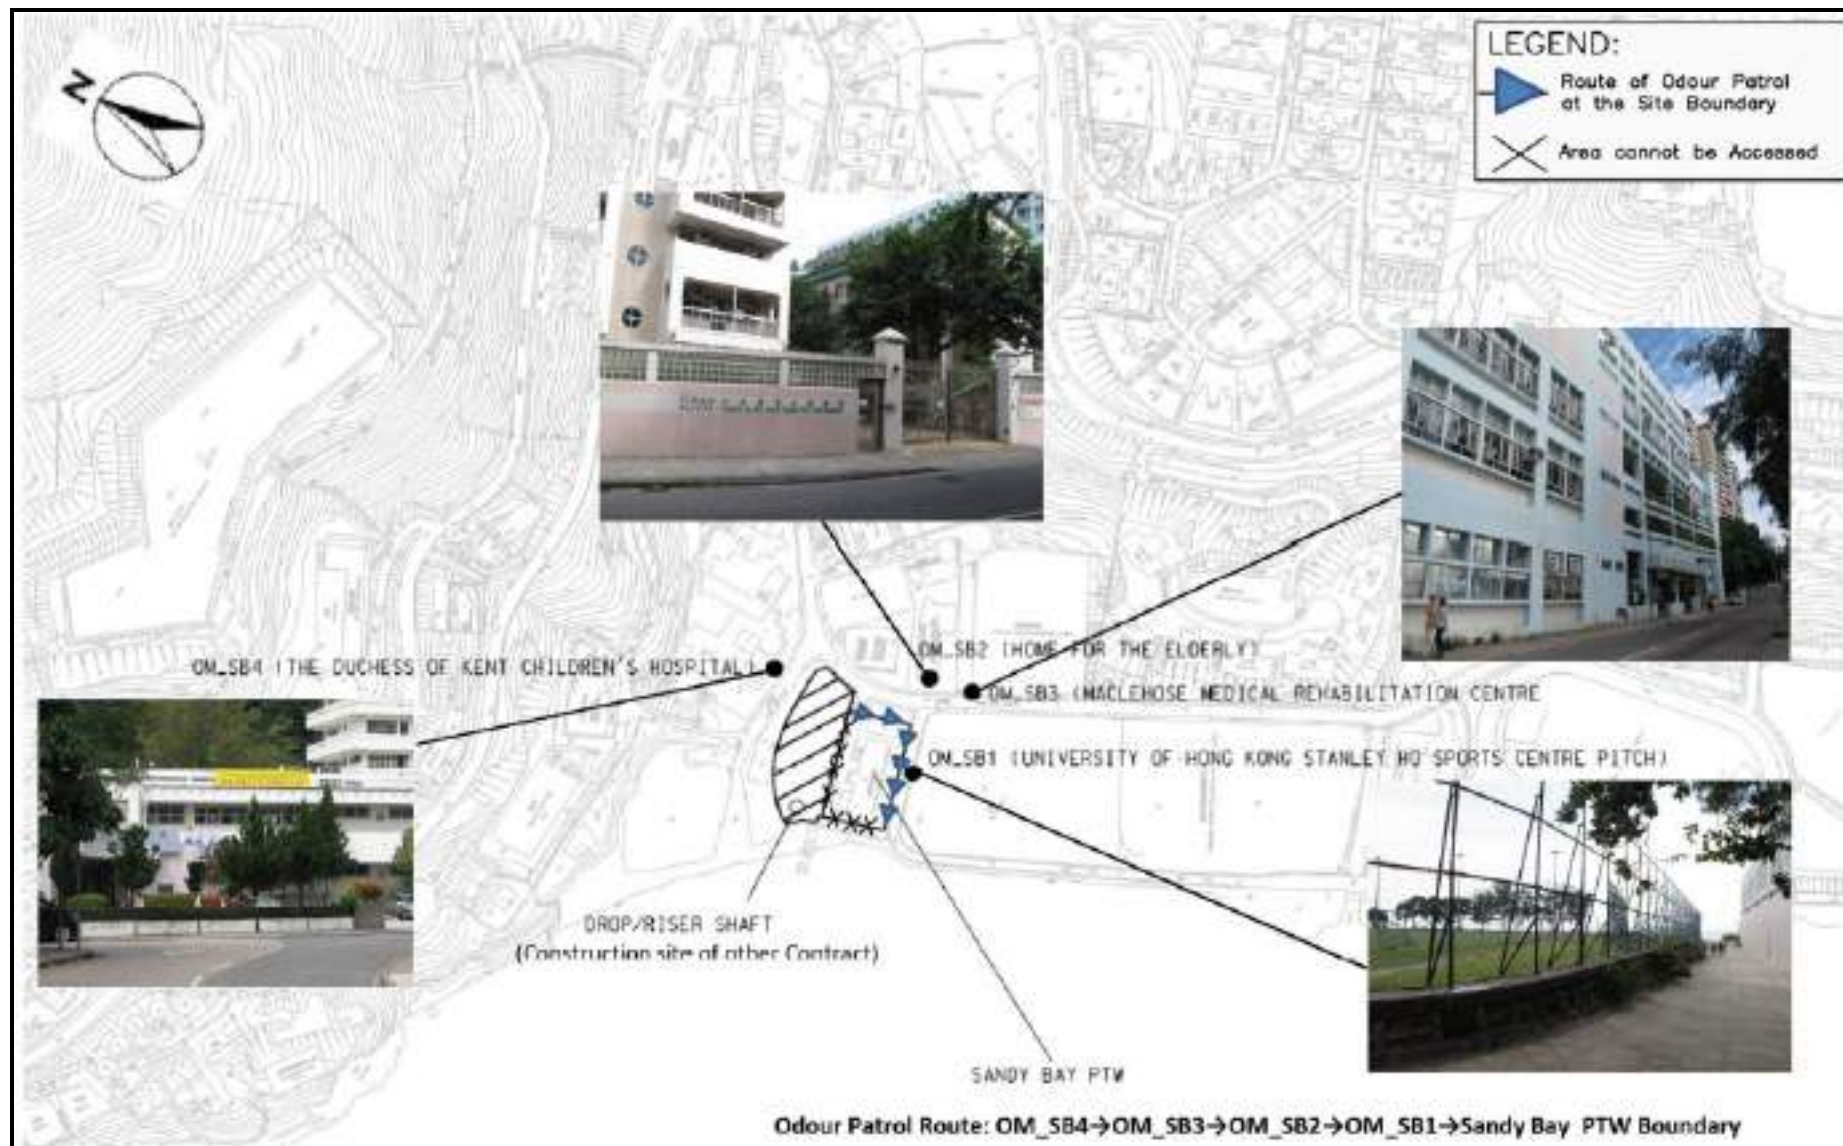


Sandy Bay PTW


Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

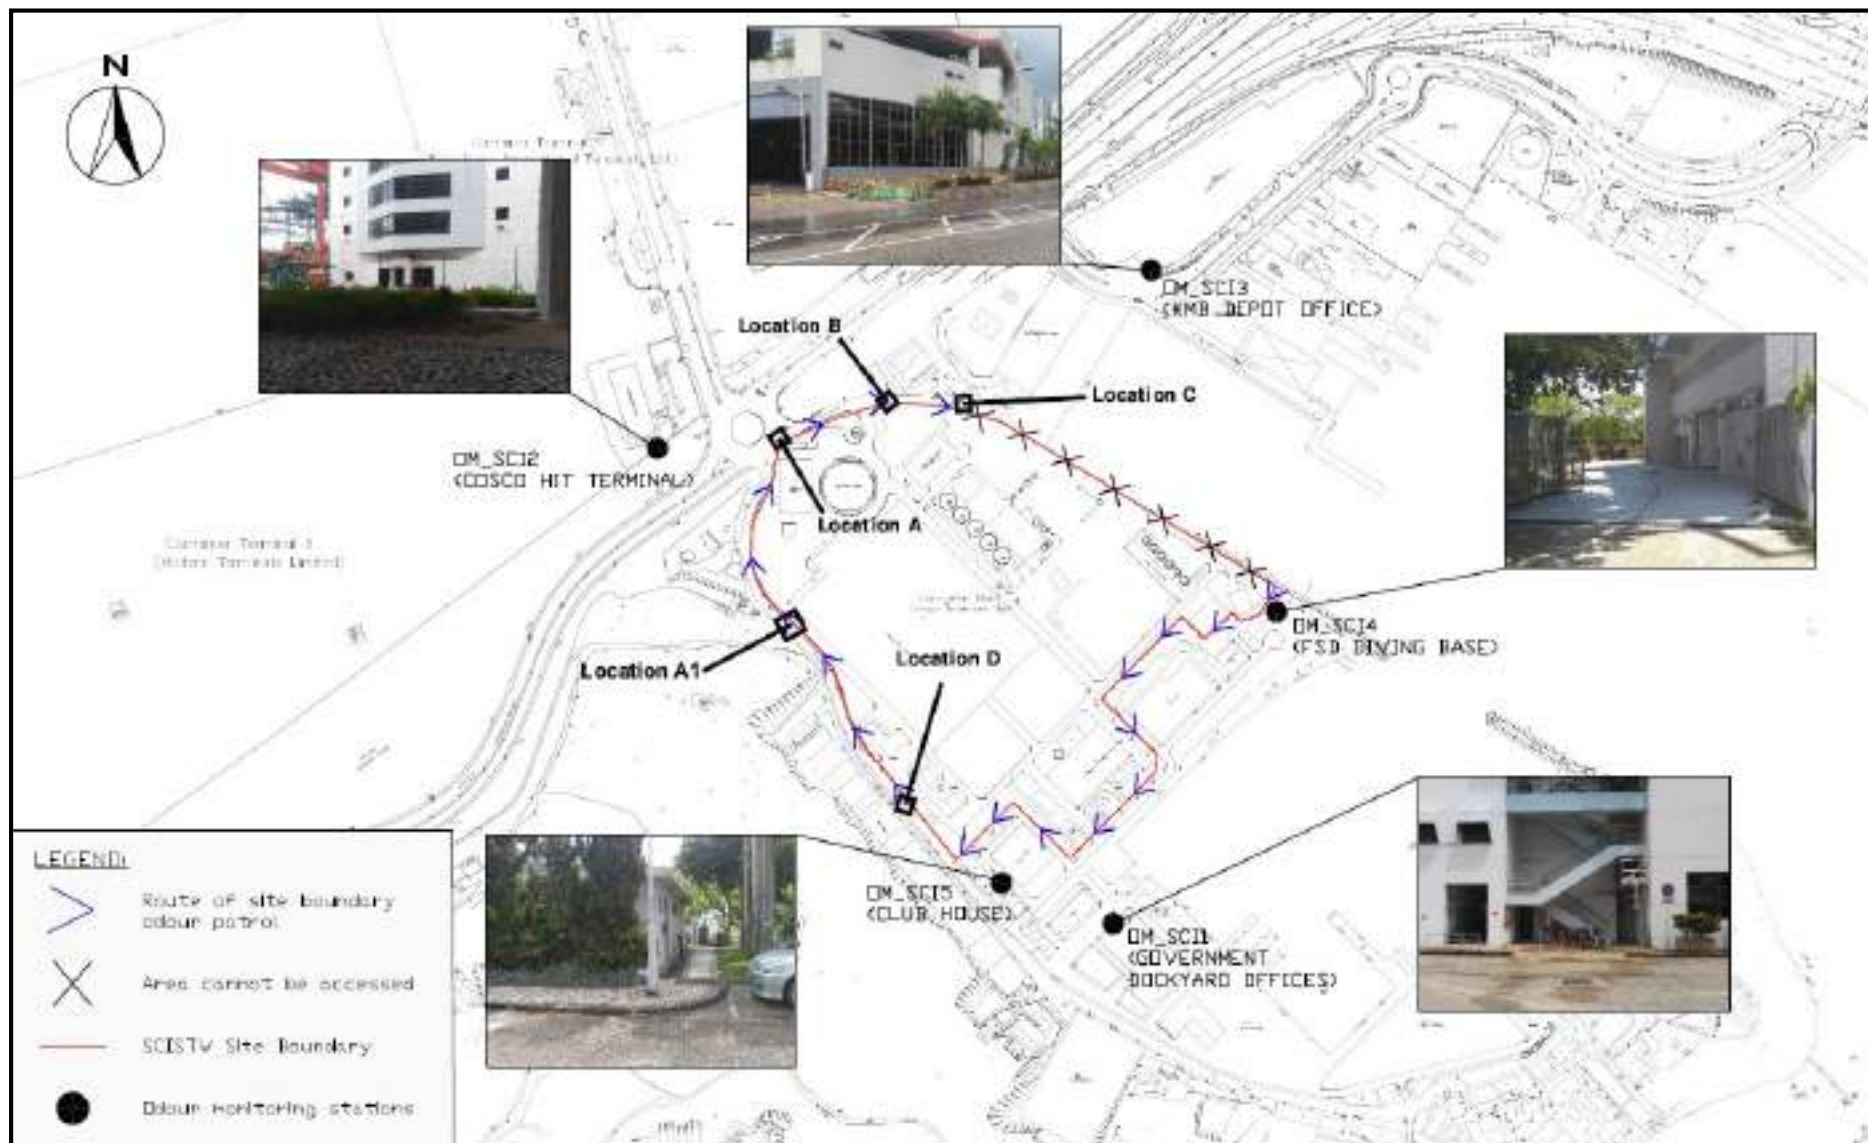


SCISTW

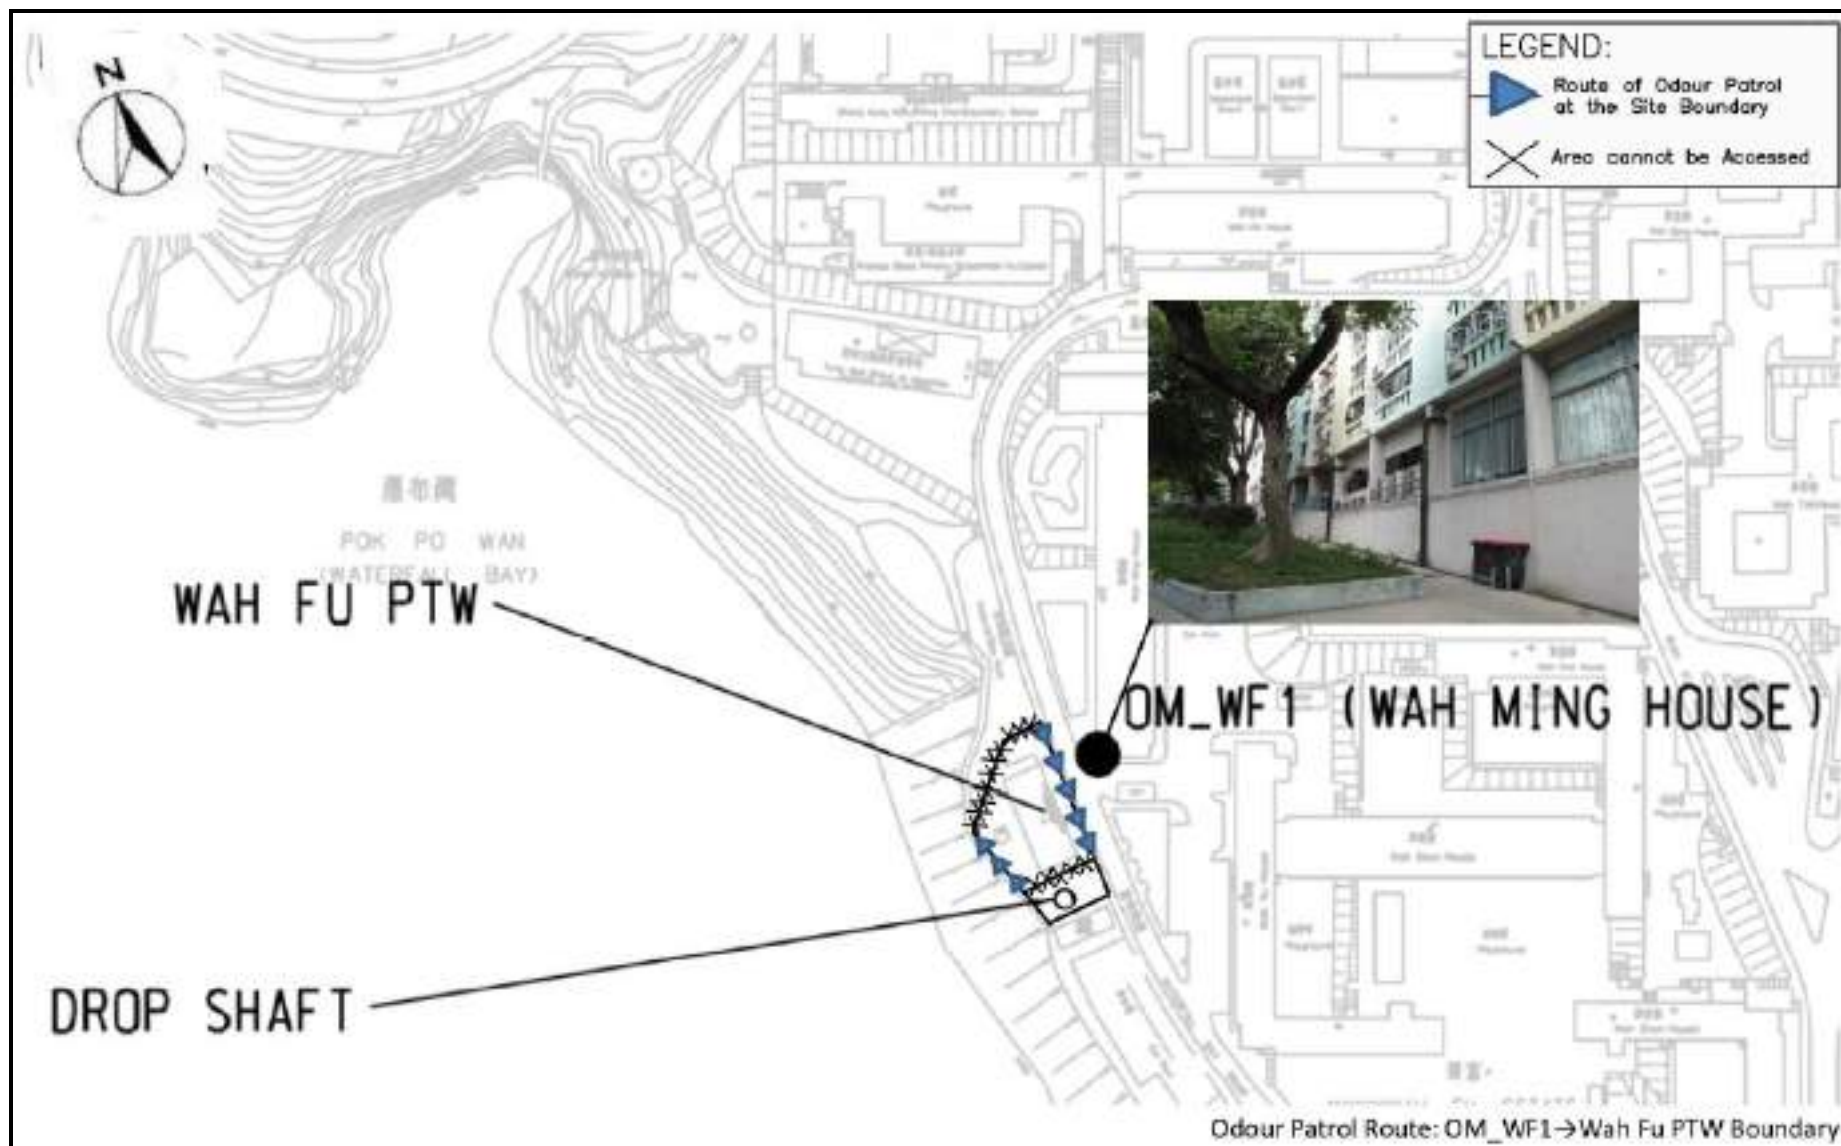

Wah Fu PTW

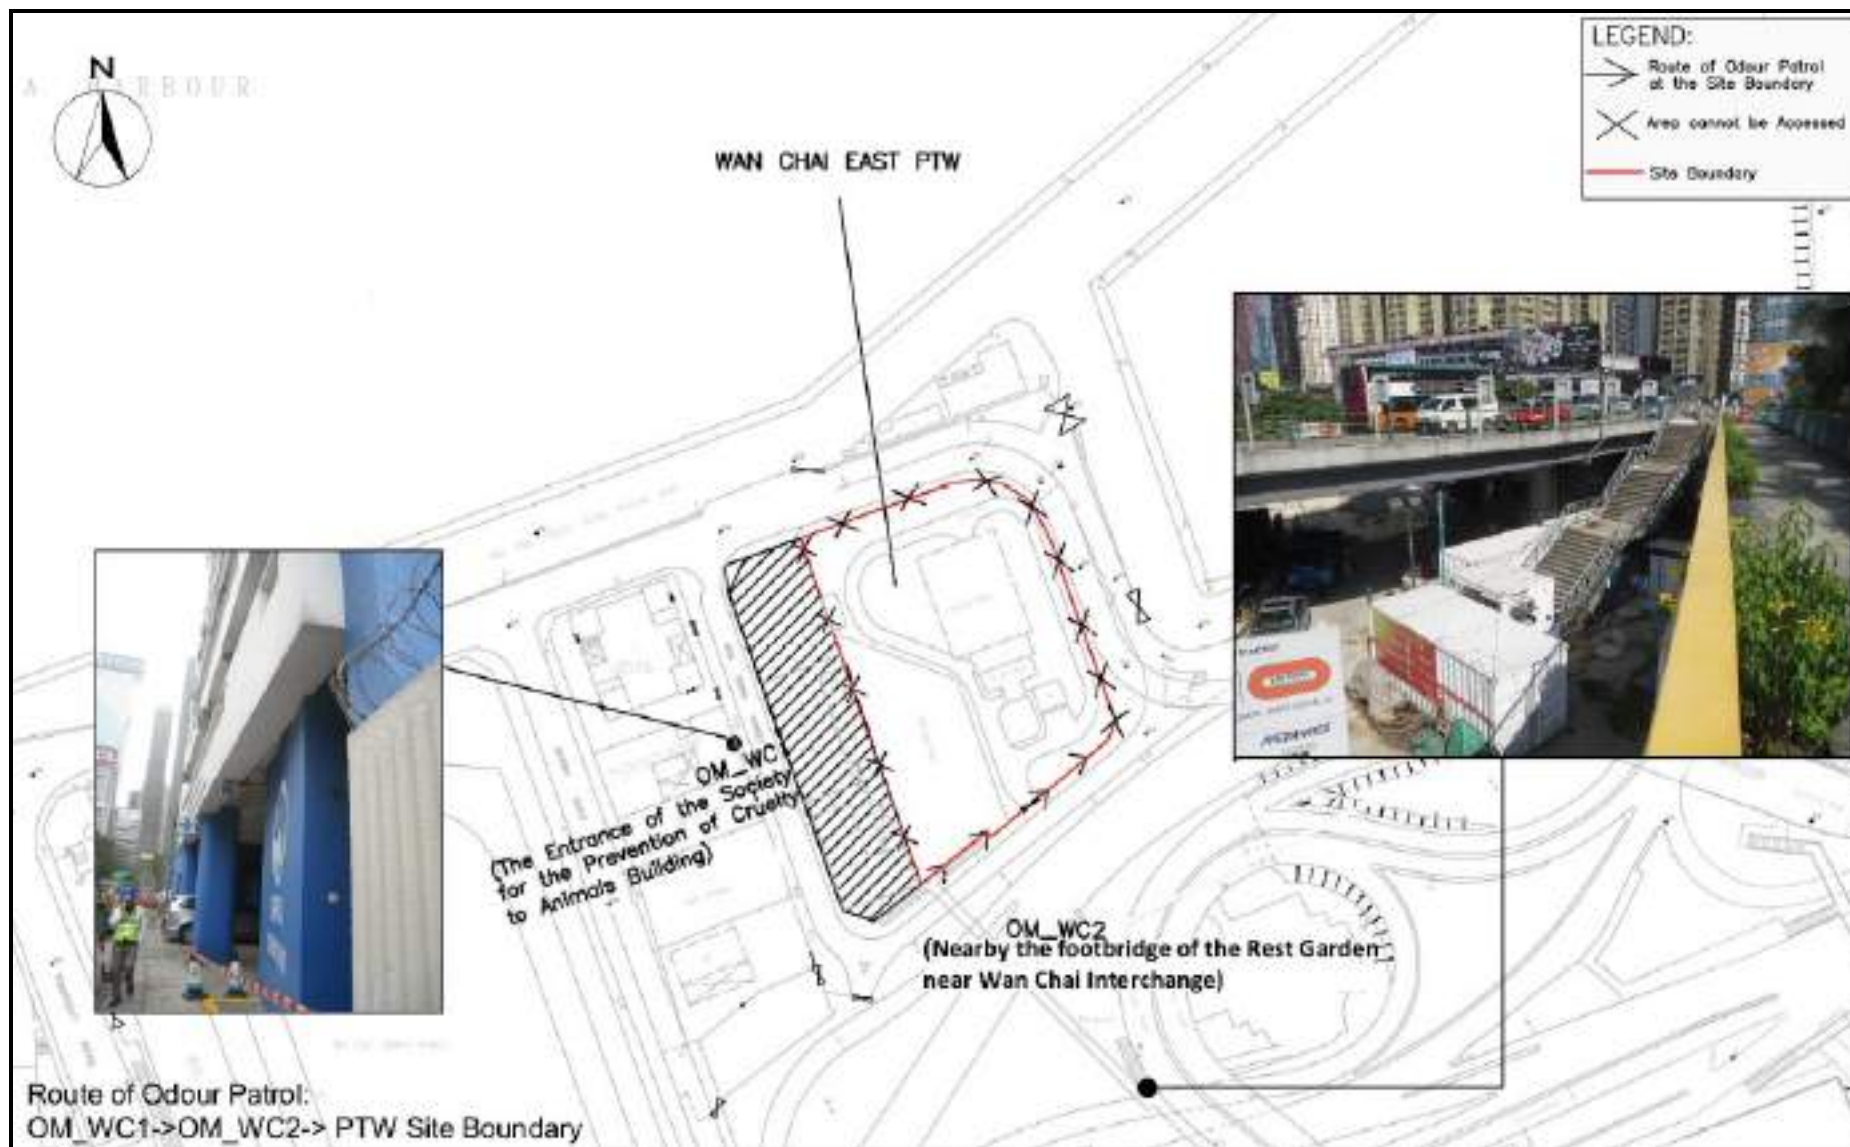

Wan Chai East PTW

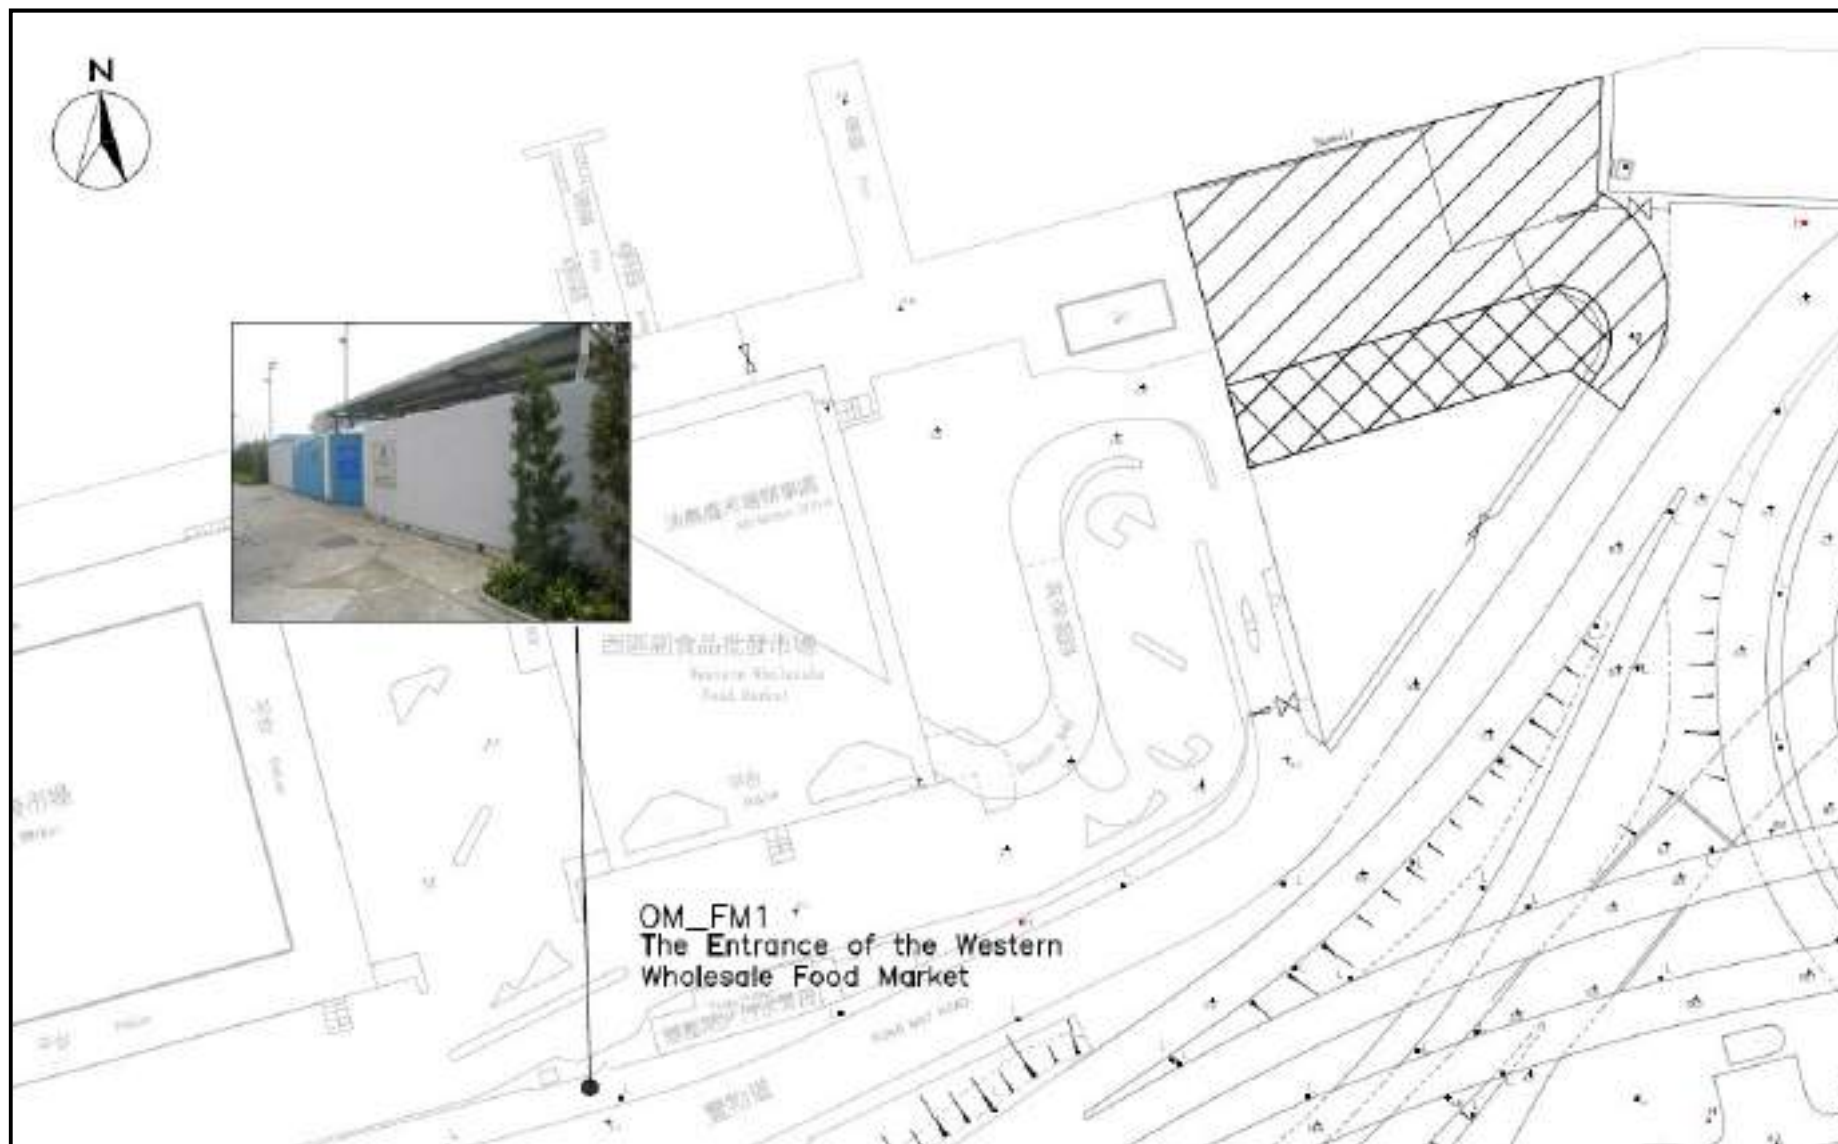

Western Wholesale Food Market

Appendix B

Odour Certificates



ALS Life Sciences | Environmental

Certificate No.: C0087-01

Certificate for a Qualified Odour Panellist

This is to certify that

CHAN Wai Hung

has participated in twelve (12) sets of individual N-Butanol screening test
during 24-Nov-2022 to 6-Jun-2023

with Individual Threshold : 49 ppb
Standard Deviation : 1.46 ppb

and

fulfil the Requirement of the European Standard Method of Air Quality -
Determination of Odour Concentration by Dynamic Olfactometry (BS EN 13725:2022) -

The Requirement of the Odour Threshold of n-Butanol in Nitrogen Gas in the Range of 20 - 80 ppb/v with at
least 12 sets of individual threshold estimates and standard deviation less than 2.3

6 June 2023

Issue Date

5 June 2024

Valid Until

Fung Lim Chee, Richard

ALS Technichem (HK) Pty Ltd

11/F Chung Shan Kitting Centre, 1-3 Wing Yip Street, Kwai Chung, NT, Hong Kong

Tel: 852-2610 1044

RIGHT SOLUTIONS | RIGHT PARTNER



ALS Life Sciences | Environmental

Certificate No.: C0698-02

Certificate for a Qualified Odour Panellist

This is to certify that

Wong Yiu Chun

has participated in twelve (12) sets of individual N-Butanol screening test
during 01-Dec-2022 to 14-Jul-2023

with Individual Threshold : 43 ppb
Standard Deviation : 1.58 ppb

and

fulfil the Requirement of the European Standard Method of Air Quality -
Determination of Odour Concentration by Dynamic Olfactometry (BS EN 13725:2022) -

The Requirement of the Odour Threshold of n-Butanol in Nitrogen Gas in the Range of 20 - 80 ppb/v with at
least 12 sets of individual threshold estimates and standard deviation less than 2.3

14 July 2023
Issue Date

13 July 2024
Valid Until


Fung Lim Chee, Richard

ALS Technichem (HK) Pty Ltd

11/F Chung Shun Knitting Centre, 1-3 Wing Yip Street, Kwai Chung, NT, Hong Kong

Tel: 852-2610 1044

RIGHT SOLUTIONS | RIGHT PARTNER



ALS Life Sciences | Environmental

Certificate No.: C0337-01

Certificate for a Qualified Odour Panellist

This is to certify that

Poon Kwong Lun, Allen

has participated in twelve (12) sets of individual N-Butanol screening test
during 24-Nov-2022 to 19-Oct-2023

with Individual Threshold : 46 ppb
Standard Deviation : 1.52 ppb

and

fulfil the Requirement of the European Standard Method of Air Quality -
Determination of Odour Concentration by Dynamic Olfactometry (BS EN 13725:2022) -

The Requirement of the Odour Threshold of n-Butanol in Nitrogen Gas in the Range of 20 - 80 ppb/v with at
least 12 sets of individual threshold estimates and standard deviation less than 2.3

19-Oct-2023
Issue Date

18-Oct-2024
Valid Until


Fung Lim Chee, Richard

ALS Technochem (HK) Pty Ltd

11/F Chung Shun Kwing Centre, 1-3 Wing Yip Street, Kwai Chung, NT, Hong Kong

Tel: 852-2610 1044

RIGHT SOLUTIONS | RIGHT PARTNER



Certificate for a Qualified Odour Panel Member

Serial No. : P-047

Odour Panel Member : Andrew Yuen

Date of Screening Test : 08 Aug 2023
10 Aug 2023
14 Aug 2023

Valid Until : 13 Feb 2024

This is to certify that Mr. Andrew Yuen participated in a set of n-butanol screening tests in our laboratory between 08 Aug 2023 and 14 Aug 2023.

The odour threshold test results of n-butanol in nitrogen gas was found to be in the range of 20 – 80 ppb/v and a standard deviation of $R < 2.3$, which comply with the requirement of the European Standard Method of Air Quality – Determination of Odour Concentration by Dynamic Olfactometry (EN 13725).

The participant is Approved and Authorized as Qualified Odour Panel Member for odour patrol and olfactometry analysis.

Signed for and on behalf of
CMA Industrial Development Foundation Limited

A handwritten signature in blue ink, appearing to read 'Winnie', is written over a horizontal line.

Tam Wing Kwun, Winnie
Assistant Manager – Environmental Division

Date: 14 Aug 2023



Certificate for a Qualified Odour Panel Member

Serial No. : P-061

Odour Panel Member : Chan Kai Fat

Date of Screening Test : 08 Aug 2023
10 Aug 2023
14 Aug 2023

Valid Until : 13 Feb 2024

This is to certify that Mr. Chan Kai Fat participated in a set of n-butanol screening tests in our laboratory between 08 Aug 2023 and 14 Aug 2023.

The odour threshold test results of n-butanol in nitrogen gas was found to be in the range of 20 – 80 ppb/v and a standard deviation of $R < 2.3$, which comply with the requirement of the European Standard Method of Air Quality – Determination of Odour Concentration by Dynamic Olfactometry (EN 13725).

The participant is Approved and Authorized as Qualified Odour Panel Member for odour patrol and olfactometry analysis.

Signed for and on behalf of
CMA Industrial Development Foundation Limited

A handwritten signature in black ink, appearing to read 'Winnie', written over a horizontal line.

Tam Wing Kwun, Winnie
Assistant Manager – Environmental Division

Date: 14 Aug 2023



Certificate for a Qualified Odour Panel Member

Serial No. : P-057

Odour Panel Member : Arnold Keung Chi Young

Date of Screening Test : 08 Aug 2023
10 Aug 2023
14 Aug 2023

Valid Until : 13 Feb 2024

This is to certify that Mr. Arnold Keung Chi Young participated in a set of n-butanol screening tests in our laboratory between 08 Aug 2023 and 14 Aug 2023.

The odour threshold test results of n-butanol in nitrogen gas was found to be in the range of 20 – 80 ppb/v and a standard deviation of $R < 2.3$, which comply with the requirement of the European Standard Method of Air Quality – Determination of Odour Concentration by Dynamic Olfactometry (EN 13725).

The participant is Approved and Authorized as Qualified Odour Panel Member for odour patrol and olfactometry analysis.

Signed for and on behalf of
CMA Industrial Development Foundation Limited

A handwritten signature in blue ink that reads 'Winnie'.

Tam Wing Kwun, Winnie
Assistant Manager – Environmental Division

Date: 14 Aug 2023

Appendix C

Field Record and Photo Record

Monitoring Result of Odour Patrol on 27 April 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_SCI1	1	Sunny	12:00	27.2	83	1.3	SW	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI2	1	Sunny	12:25	27.2	83	2.0	NE	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI3	1	Sunny	12:30	27.1	83	0.7	SE	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI4	1	Sunny	12:04	27.2	83	1.4	E	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI5	1	Sunny	12:10	27.1	83	0.5	S	0	NA	NA	NA	NA
	2							0				
	3							0				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_NP1	1	Clear	14:19	22.3	50	1.4	E	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_NP2	1	Clear	14:24	22.8	50	0.7	N	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_NP3	1	Clear	14:30	22.8	50	0.2	NW	0	NA	NA	NA	NA
	2							0				
	3							0				
North Point PTW Boundary	1	Clear	12:40	24.0	62.8	0.4	N	1	Continuous	Side wind	Garbage / Sewage/ Grassy	Garbage Collection Station / PTW/ Trees
	2							1				
	3							1				
OM_WC1	1	Clear	15:05	25.2	47	0.5	N	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_WC2	1	Clear	15:15	24.6	47	1.1	NW	0	NA	NA	NA	NA
	2							0				
	3							0				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
Wan Chai East PTW Boundary	1	Clear	12:25	24.0	63.1	1.2	N	1	Continuous	Side wind	Sewage	PTW
	2							1				
	3							1				
OM_C1	1	Clear	15:40	23.2	48	0.5	NW	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_C2	1	Clear	15:42	23.8	47	0.8	N	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_C3	1	Clear	15:33	23.8	47	0.5	N	0	NA	NA	NA	NA
	2							0				
	3							0				
Central PTW Boundary	1	Clear	10:14	23.2	59.4	0.5	SE	2	Continuous	Side wind	Solvent	Playground maintenance works located opposite to the Central PTW
	2							2				
	3							2				
OM_FM1	1	Clear	15:49	23.4	47	1.2	NE	0	NA	NA	NA	NA
	2							0				
	3							0				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_SB1	1	Clear	16:10	22.9	47	1.2	W	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SB2	1	Clear	16:06	23.5	47	0.9	W	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SB3	1	Clear	16:13	23	47	0.3	W	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SB4	1	Clear	16:20	23.6	47	0.2	W	0	NA	NA	NA	NA
	2							0				
	3							0				
Sandy Bay PTW Boundary	1	Clear	10:45	21.1	54.2	1.1	W	1	Continuous	Downwind	Sewage / Urine	PTW/ Footpath near the PTW
	2							1				
	3							1				
OM_CB1	1	Clear	16:23	23.5	49	0.2	W	0	NA	NA	NA	NA
	2							0				
	3							0				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_CB2	1	Clear	16:25	23.5	49	0.2	W	0	NA	NA	NA	NA
	2							0				
	3							0				
Cyberport PTW Boundary	1	Clear	10:59	22.8	55.4	0	--	1	Continuous	NA	Sewage	PTW
	2							1				
	3							1				
OM_WF1	1	Clear	16:34	23.1	49	0.3	NW	0	NA	NA	NA	NA
	2							0				
	3							0				
Wah Fu PTW Boundary	1	Clear	11:18	23.3	64.9	0.6	W	1	Continuous	Side wind	Sewage/ Painting	PTW
	2							1				
	3							2				
OM_AB1	1	Clear	17:02	22.9	48	1.4	E	0	NA	NA	NA	NA
	2							0				
	3							0				
Aberdeen PTW Boundary	1	Clear	11:42	23.0	59.1	1.2	E	1	Continuous	Side wind	Sewage/ Grassy	PTW/ Vegetation
	2							1				
	3							1				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_ALC1	1	Clear	16:52	22.6	48	0.4	NE	0	NA	NA	NA	NA
	2							0				
	3							0				
Ap Lei Chau PTW Boundary	1	Clear	11:59	24.3	63.9	0.3	N	2	Continuous	Upwind	Sewage	PTW
	2							1				
	3							1				
OM_SCI1	1	Clear	12:25	22.4	52	0.5	NE	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI2	1	Clear	12:32	22.5	53	0.5	SE	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI3	1	Clear	12:35	22.4	53	0.3	SW	0	NA	NA	NA	NA
	2							0				
	3							0				
OM_SCI4	1	Clear	12:20	22.4	52	0.9	SE	0	NA	NA	NA	NA
	2							0				
	3							0				

Monitoring Result of Odour Patrol on 27 December 2023

Location ID	Panellist	Weather	Time	Temperature (°C)	Relative Humidity (%)	Wind Speed (m/s)	Wind Direction	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
											Odour Characteristics	Potential Odour Source
OM_SCI5	1	Clear	12:28	22.5	53	0.7	NE	0	NA	NA	NA	NA
	2							0				
	3							0				
SCISTW-Location A	1	Clear	9:47	20.3	63.6	0.7	N	1	Intermittent	Side wind	Rubbish	Refuse Collection Vehicles
	2							1				
	3							1				
SCISTW-Location A1	1	Clear	9:51	21.2	64.6	0	--	0	NA	NA	NA	NA
	2							0				
	3							0				
SCISTW-Location B	1	Clear	9:44	20.8	66.2	0	--	2	Continuous	NA	Rubbish/ Vehicles exhaust	Refuse Collection Vehicles
	2							2				
	3							2				
SCISTW-Location C	1	Clear	9:41	21.0	64.6	0.3	SE	2	Continuous	Side wind	Rubbish	Refuse Collection Vehicles/ Refuse Transfer Station
	2							2				
	3							2				
SCISTW-Location D	1	Clear	9:54	21.4	62.8	0	--	1	Intermittent	NA	Sewage	SCISTW
	2							0	NA		NA	NA
	3							0				

Photo Record of Odour Patrol on 27 April 2023




	
<p>OM_SCI1</p>	<p>OM_SCI2</p>
	
<p>OM_SCI3</p>	<p>OM_SCI4</p>
	
<p>OM_SCI5</p>	

Photo Record of Odour Patrol on 27 December 2023







	
<p>OM_NP1</p>	<p>OM_NP2</p>
	
<p>OM_NP3</p>	<p>North Point PTW Boundary</p>
	
<p>OM_WC1</p>	<p>OM_WC2</p>

Photo Record of Odour Patrol on 27 December 2023

 <p>A photograph showing the entrance to a residential area. A brick wall with a metal gate is in the foreground. Two people are standing near the gate. In the background, a building is partially covered with green scaffolding.</p>	 <p>A photograph of a long, white, curved wall that runs along a paved area. There are some trees and a building visible in the background.</p>
<p>Wan Chai East PTW Boundary</p>	<p>OM_C1</p>
 <p>A photograph of a modern, multi-story building with a glass facade. A paved area with some plants and a few people is in the foreground.</p>	 <p>A photograph of a paved area with several vertical metal posts. A building with a glass facade is visible in the background.</p>
<p>OM_C2</p>	<p>OM_C3</p>
 <p>A photograph of a stone wall with a metal gate. Two people are standing near the gate. A building is visible in the background.</p>	 <p>A photograph of a large, white, industrial-looking building with a blue roof. A paved area and some trees are in the foreground.</p>
<p>Central PTW Boundary</p>	<p>OM_FM1</p>

Photo Record of Odour Patrol on 27 December 2023

	
<p>OM_SB1</p>	<p>OM_SB2</p>
	
<p>OM_SB3</p>	<p>OM_SB4</p>
	
<p>Sandy Bay PTW Boundary</p>	<p>OM_CB1</p>

Photo Record of Odour Patrol on 27 December 2023











	
<p>OM_CB2</p>	<p>Cyberport PTW Boundary</p>
	
<p>OM_WF1</p>	<p>Wah Fu PTW Boundary</p>
	
<p>OM_AB1</p>	<p>Aberdeen PTW Boundary</p>

Photo Record of Odour Patrol on 27 December 2023

	
OM_ALC1	Ap Lei Chau PTW Boundary
	
OM_SCI1	OM_SCI2
	
OM_SCI3	OM_SCI4

Photo Record of Odour Patrol on 27 December 2023


	
<p>OM_SCI5</p>	<p>Location A</p>
	
<p>Location A1</p>	<p>Location B</p>
	
<p>Location C</p>	<p>Location D</p>

Appendix D

Meteorological Information from the Hong Kong Observatory Station

Meteorological Information from the Hong Kong Observatory Station

- Temperature and Humidity

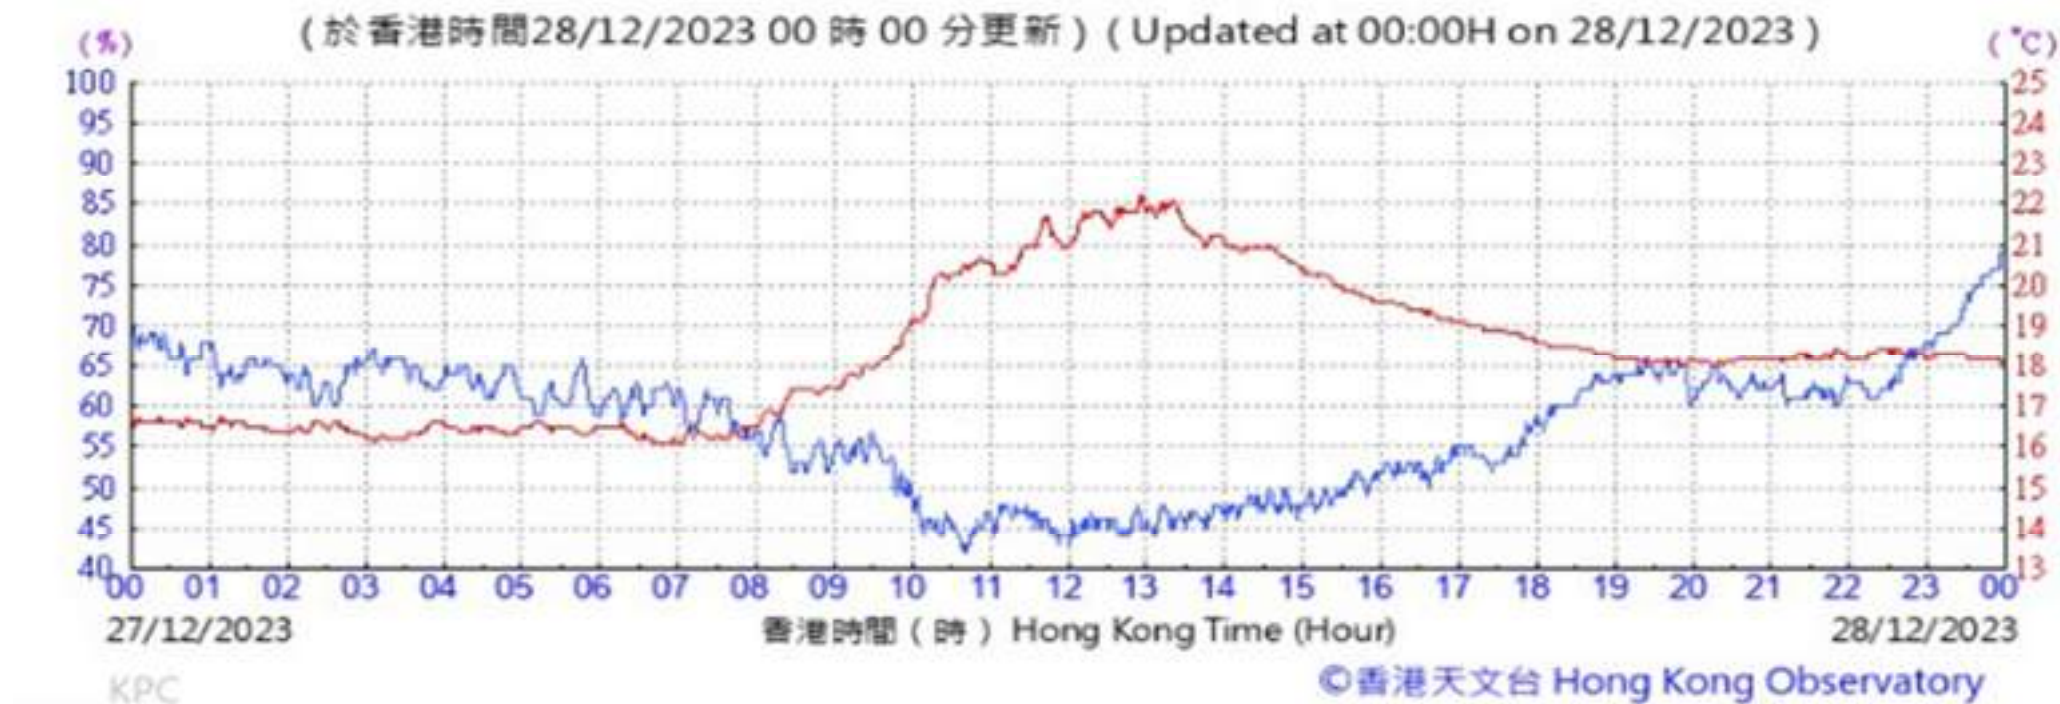

Reference from:

https://www.hko.gov.hk/en/wxinfo/ts/display_graph.htm?hko&

&


https://i-lens.hk/hkweather/daily_extract.php?date=2023-04-27

https://i-lens.hk/hkweather/daily_extract.php?date=2023-12-27


Remark: The meteorological data chart from the Hong Kong Observatory Station for 27th April 2023 was not available.

Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

- Wind Direction

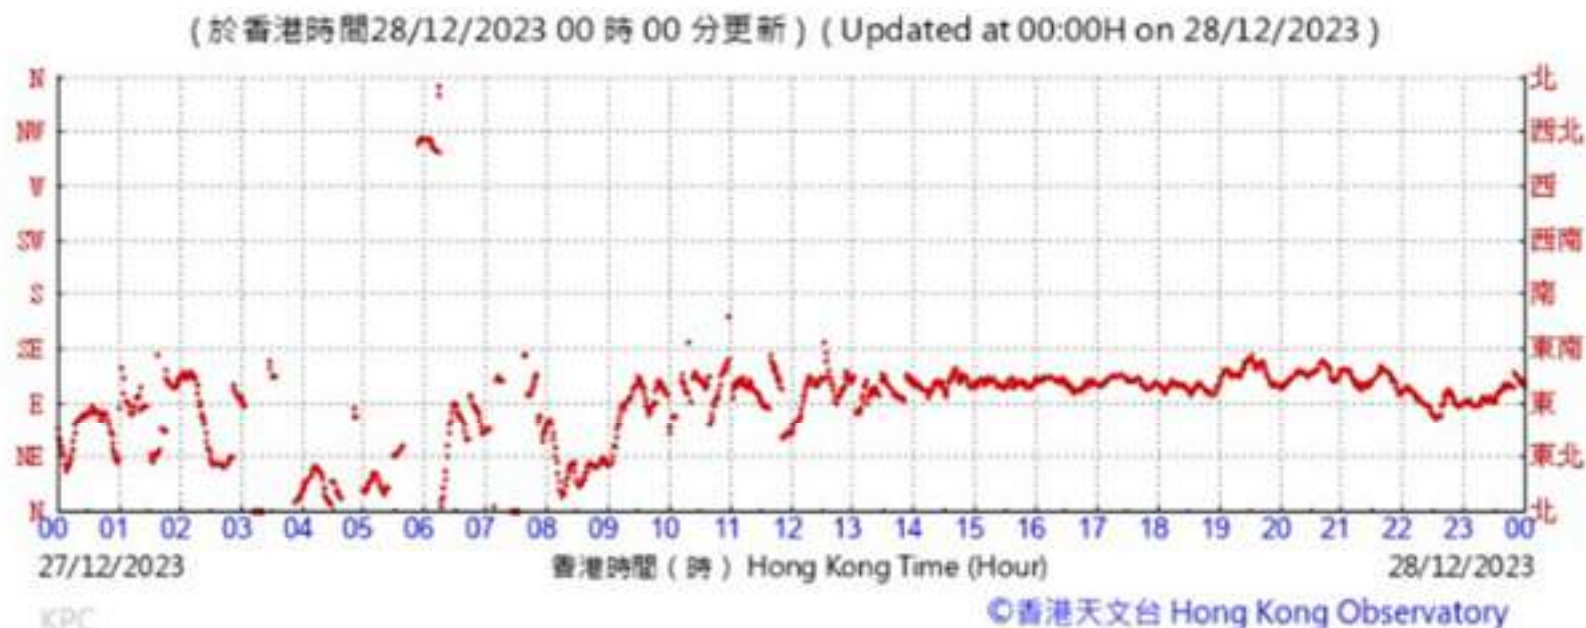


- Wind Speed

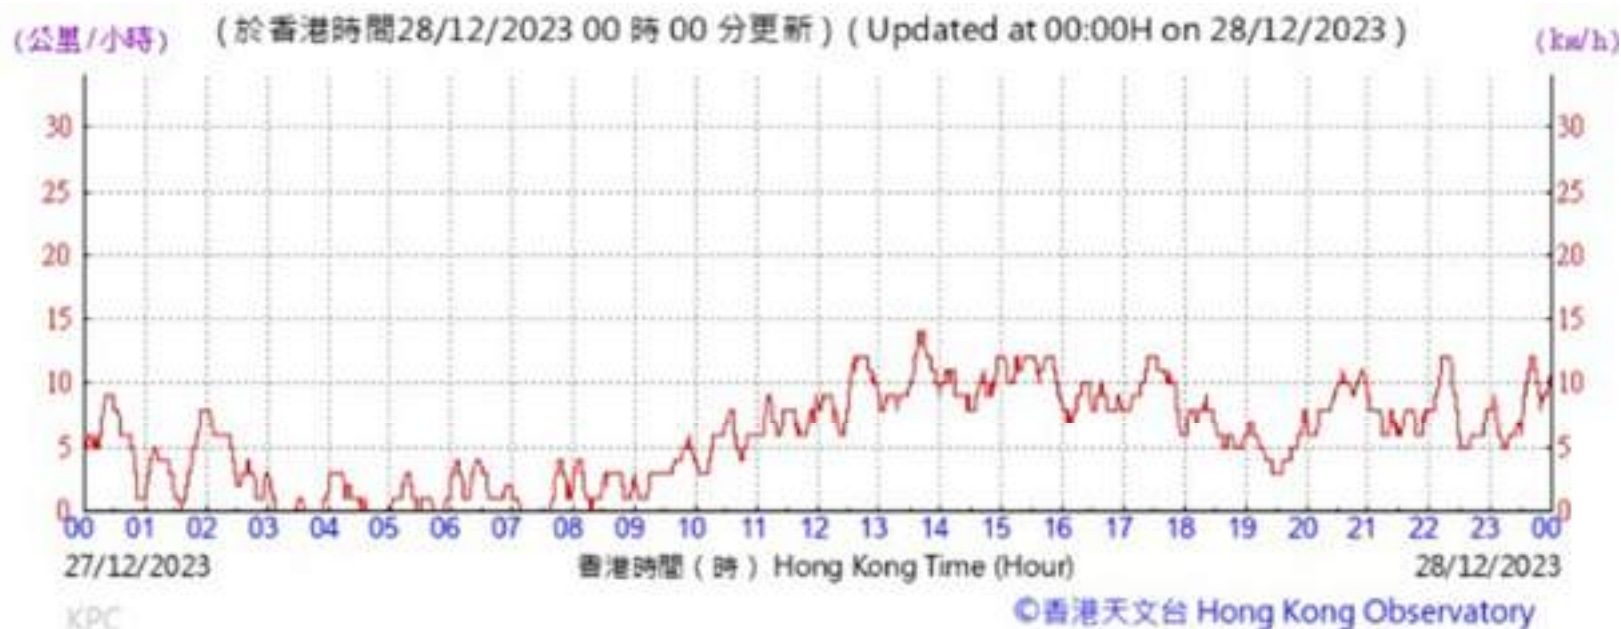

Appendix E

Layout of Odour Monitoring Locations for Odour Measurement

Monitoring Location of Deodourization Unit in SCISTW

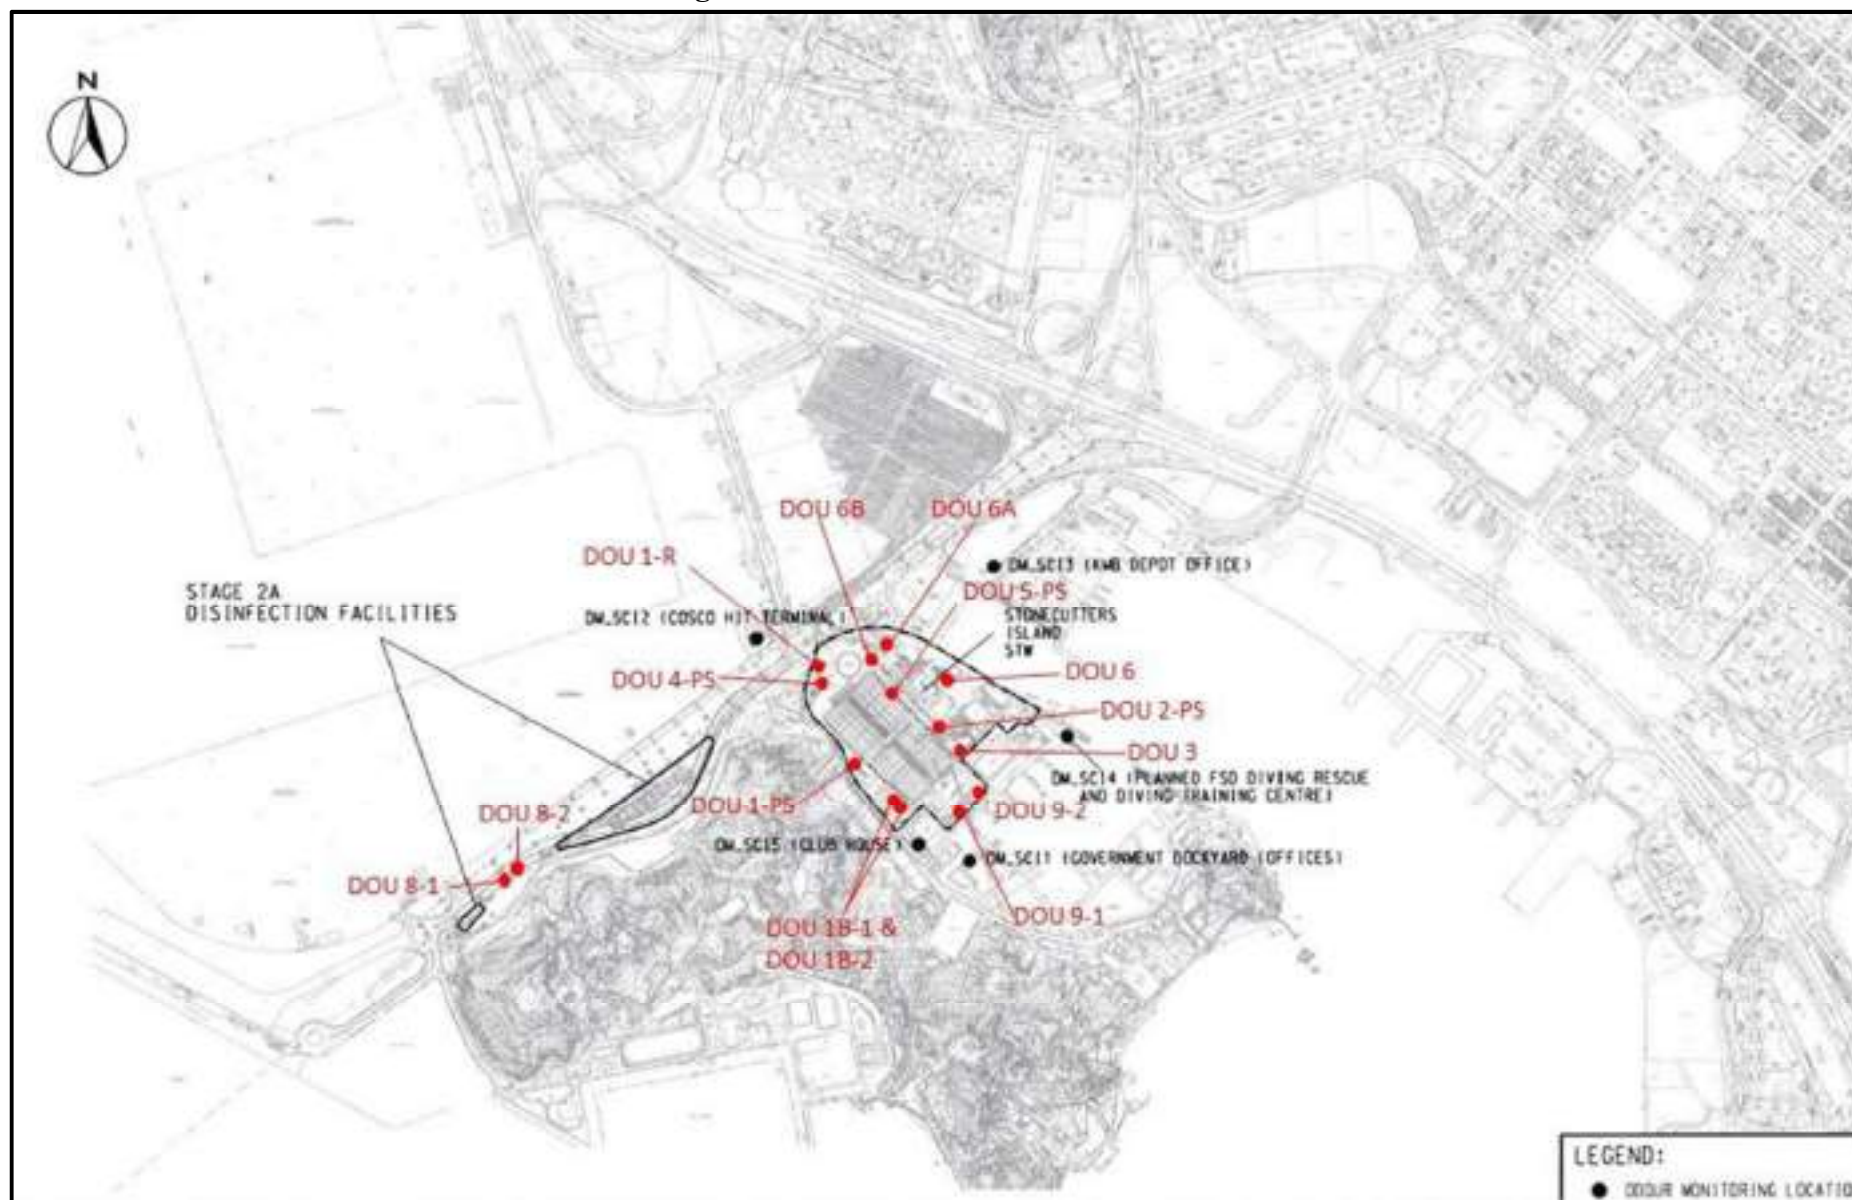

Remark:

1. DOU 3 stated on map was replaced by DOU 2PS-ACF.

Sampling Location Photos on 27 April 2023

			
DOU 1B-1	DOU 1B-2	DOU 1-PS	DOU 1-R
			
DOU 2-PS	DOU 2PS-ACF	DOU 4-PS	DOU 5-PS

Sampling Location Photos on 27 April 2023

			
DOU 6	DOU 6A	DOU 6B	DOU 8-1
			
DOU 8-2	DOU 9-1	DOU 9-2	

Appendix F

Odour Measurement Result

Sampling Record - SCI STW

Sampling Location	Date	Time	Odour Concentration (OU _E /m ³)	H ₂ S Concentration (ppb)	Temperature (°C)	Humidity (%)	Wind Speed (m/s)	Wind Direction	Duct Volumetric Flow Rate (m ³ /hr)	Odour Emission Rate (OU/s)
DOU 1B-1	27-Apr-2023	14:44	50	27	30	51	0.6	SE	2,826	39
DOU 1B-2		14:54	39	27	31	51	0.7	SE	2,796	30
DOU 1-PS		15:15	38	4	30	53	1.3	SW	39,226	414
DOU 1-R		15:30	79	15	32	48	0.8	W	2,151	47
DOU 2-PS		12:00	26	4	30	51	1.4	E	33,670	243
DOU 2PS-ACF		12:20	38	5	33	45	0.9	E	38,191	403
DOU 4-PS		15:45	32	8	32	48	0.8	S	34,651	308
DOU 5-PS		11:20	11	<1	26	64	0.8	E	42,530	130
DOU 6		11:40	31	4	28	55	0.6	E	24,731	213
DOU 6A		10:39	25	4	27	68	< 0.1	-	32,939	229
DOU 6B		11:00	18	<1	25	71	0.6	N	27,540	138
DOU 8-1		16:15	27	3	28	61	0.6	N	2,645	20
DOU 8-2		16:00	34	5	28	60	0.5	N	2,645	25
DOU 9-1		14:30	79	30	28	60	0.6	SW	4,255	93
DOU 9-2		14:37	200	120	29	58	0.6	SW	4,255	236
Total Odour Emission Rate (OU/s)										2,568

Appendix G

Total Odour Emission Rate Extracted from EIA Report

Odour Monitoring Report for Harbour Area Treatment Scheme Stage 2A (Operational Phase) April 2023

Facility	Unmitigated odour Emission Rate, ou/s	Deodourizer Requirement					Mitigated Odour Emission Rate, ou/s
		Deodourizer Discharge ID	Discharge Height, m	Total Discharge Cross-sectional Area, m²	Discharge velocity, m/s	Total no. of discharge point	
Option 2 - Decentralized Design							
CEPT Facilities (Odd No. Units) & Flow Distribution Channel)	146162.21	S-O2-DO1	12	1.86	20	1	4384.87
CEPT Facilities (Even No. Units) & NWKPS + NWKPS O/F chamber	136086.21	S-O2-DO2	12	1.86	20	1	4082.59
Sludge TreatmentFacilities (include Sludge Storage Tanks, Sludge Dewatering Building 1 & 2, Existing and New Sludge Cake Silos)	19057.82	S-O2-DO3	6	2.40	12.58	3	571.73
Stage 1 MPS & Riser Shaft	6518.89	S-O2-DO4	18	1.13	12.28	4	195.57
Stage 2A MPS & Riser Shaft	6518.89	S-O2-DO5	18	1.13	12.28	4	195.57
NWKPTW	19963.88	S-O2-DO6	13	2.26	12.28	8	598.92
Flow DistributionChambers	2688.01	S-O2-DO7	4.5	0.32	10.48	2	80.64
New Flow Distribution Chamber							
Chlorination Contact Tank	37776.64	S-C-DO1	11	1.13	7.2	4	1133.30
Drop Shaft and Chamber 15A	2630.22	S-C-DO2	4	0.57	8.84	2	263.02

Note: (1) CEPT facilities include Influent upflow structure, distribution channel, flocculation tanks, sedimentation tanks and effluent weirs, drop shafts, scum pit and rapid mixing tank of sedimentation tanks

(2) MPS is Main Pumping Station

(3) NWKPTW, NWKPS and NWKO/F chambers are North West Kowloon PTW, NWKPTW Pumping Station and NWKPTW Overflow Chamber, respectively

(4) The emission rate included a 1.31 ambient temperature correction factor.

Total Mitigated Odour Emission Rate, ou/s: 11,506.21

Reference:

https://www.epd.gov.hk/eia/register/report/eiareport/eia_1482008/EIA/pdf/Text/S3%20Air.pdf